






FIRE SAFETY RESEARCH INSTITUTE

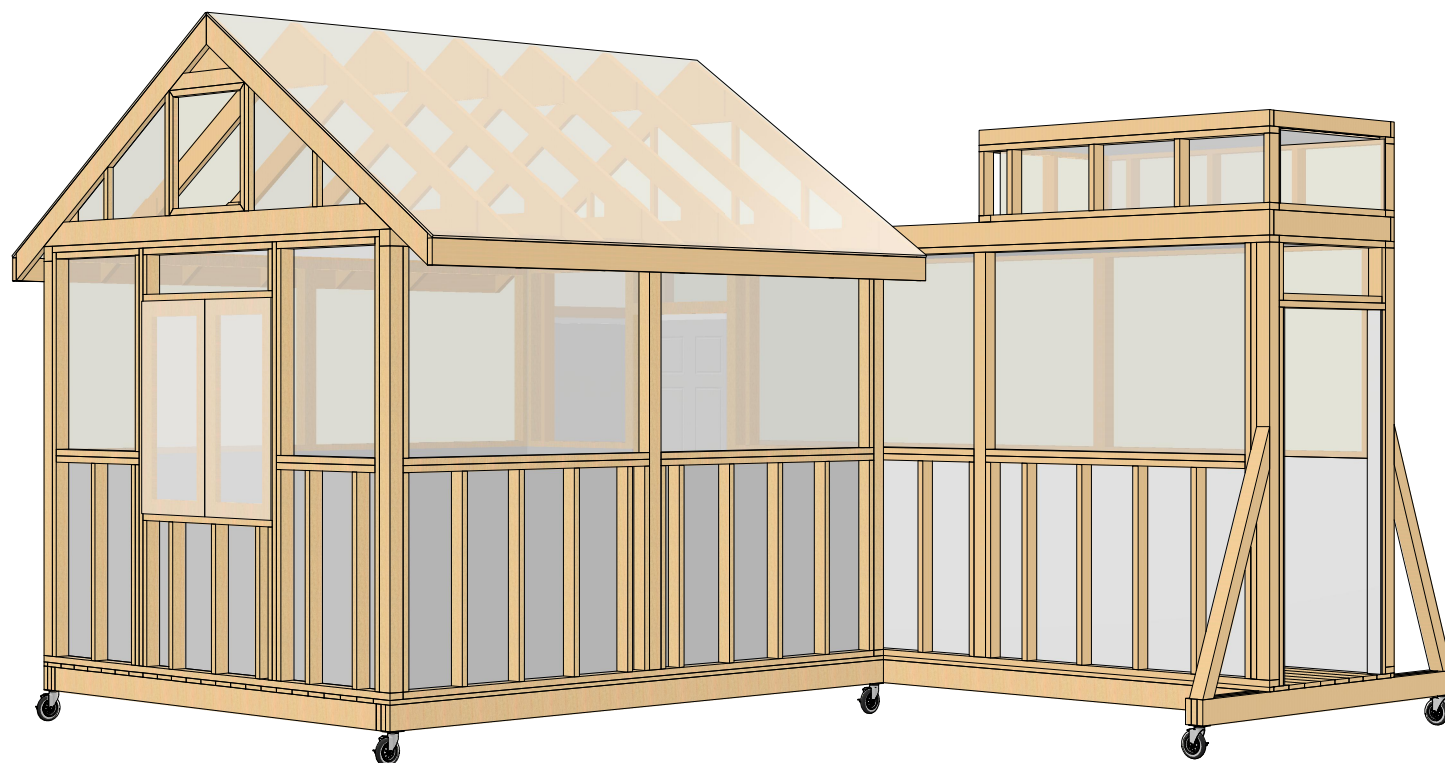

HOSE STREAM PROP
ASSEMBLED VIEWS

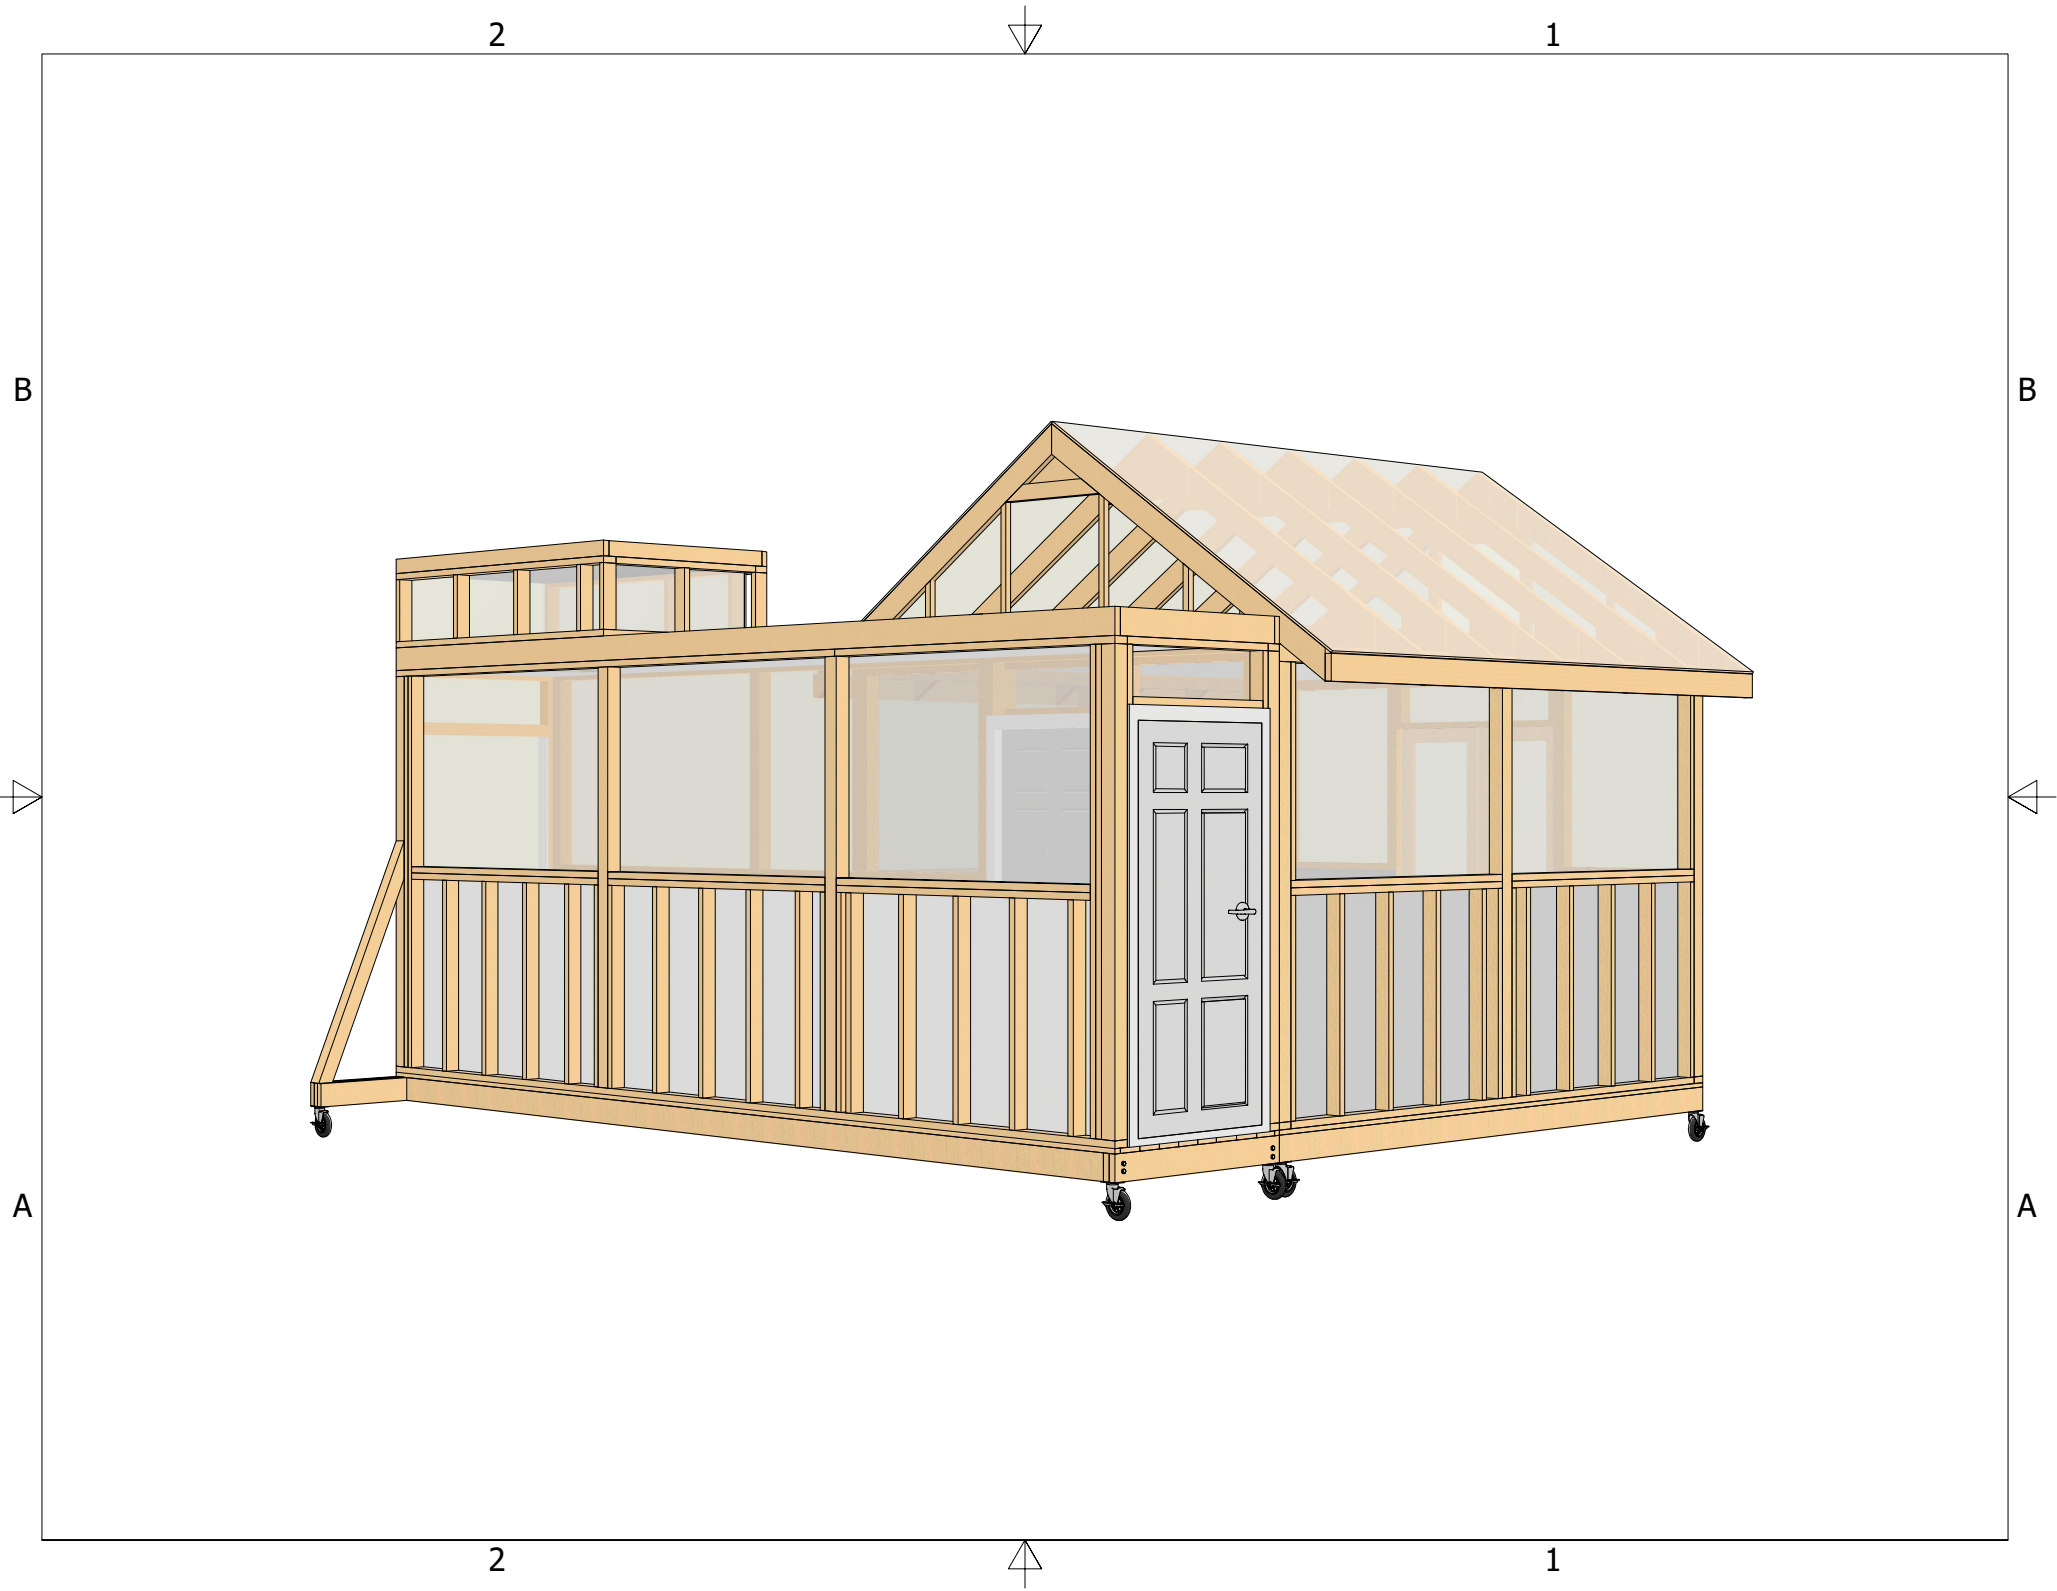

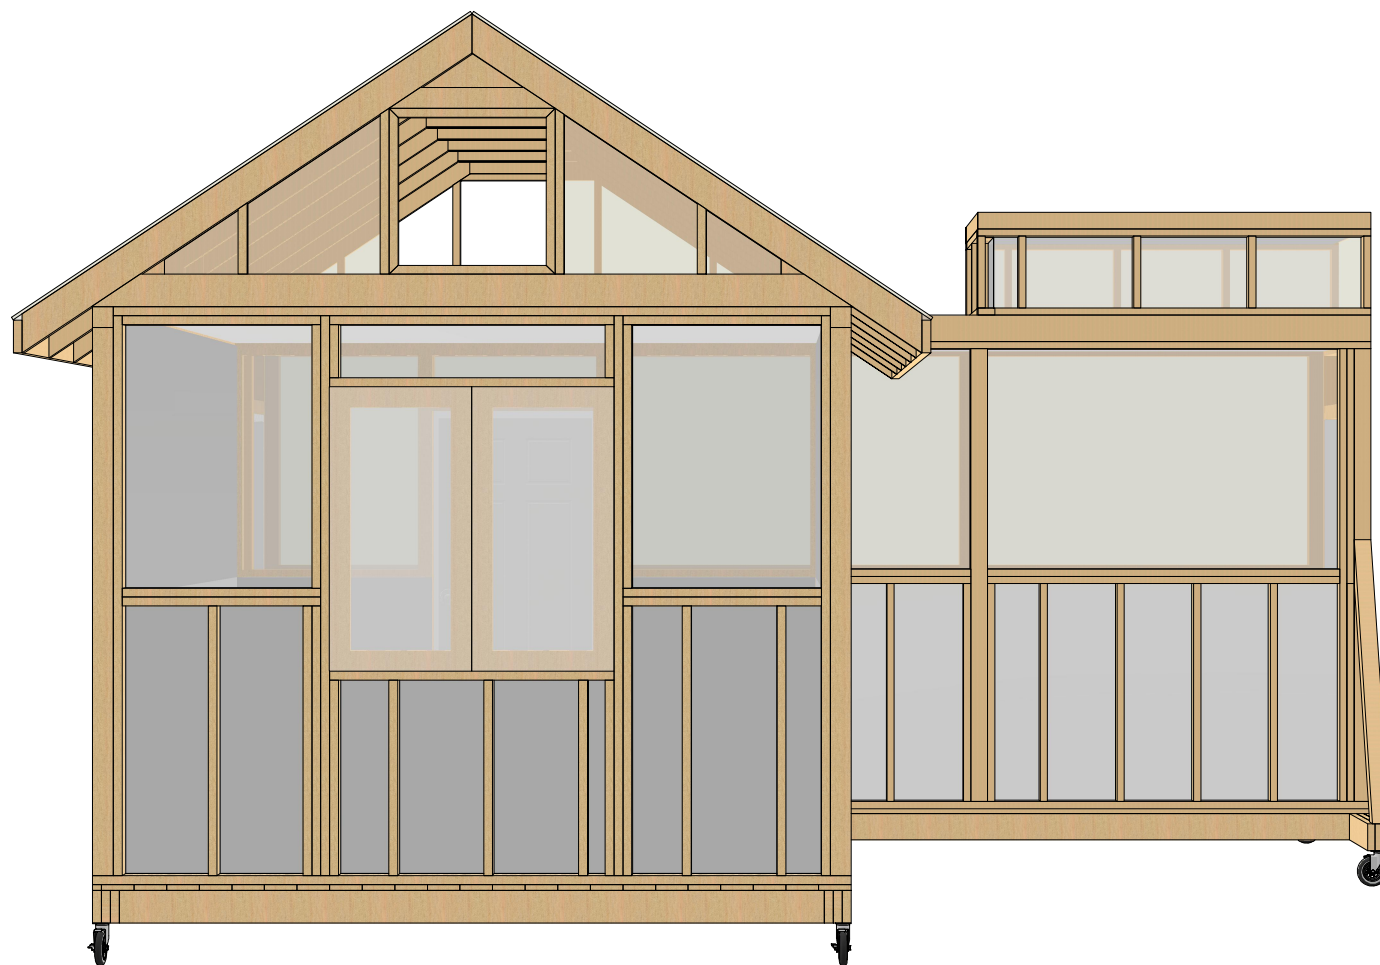

2

1

B


B


A


A

2

1

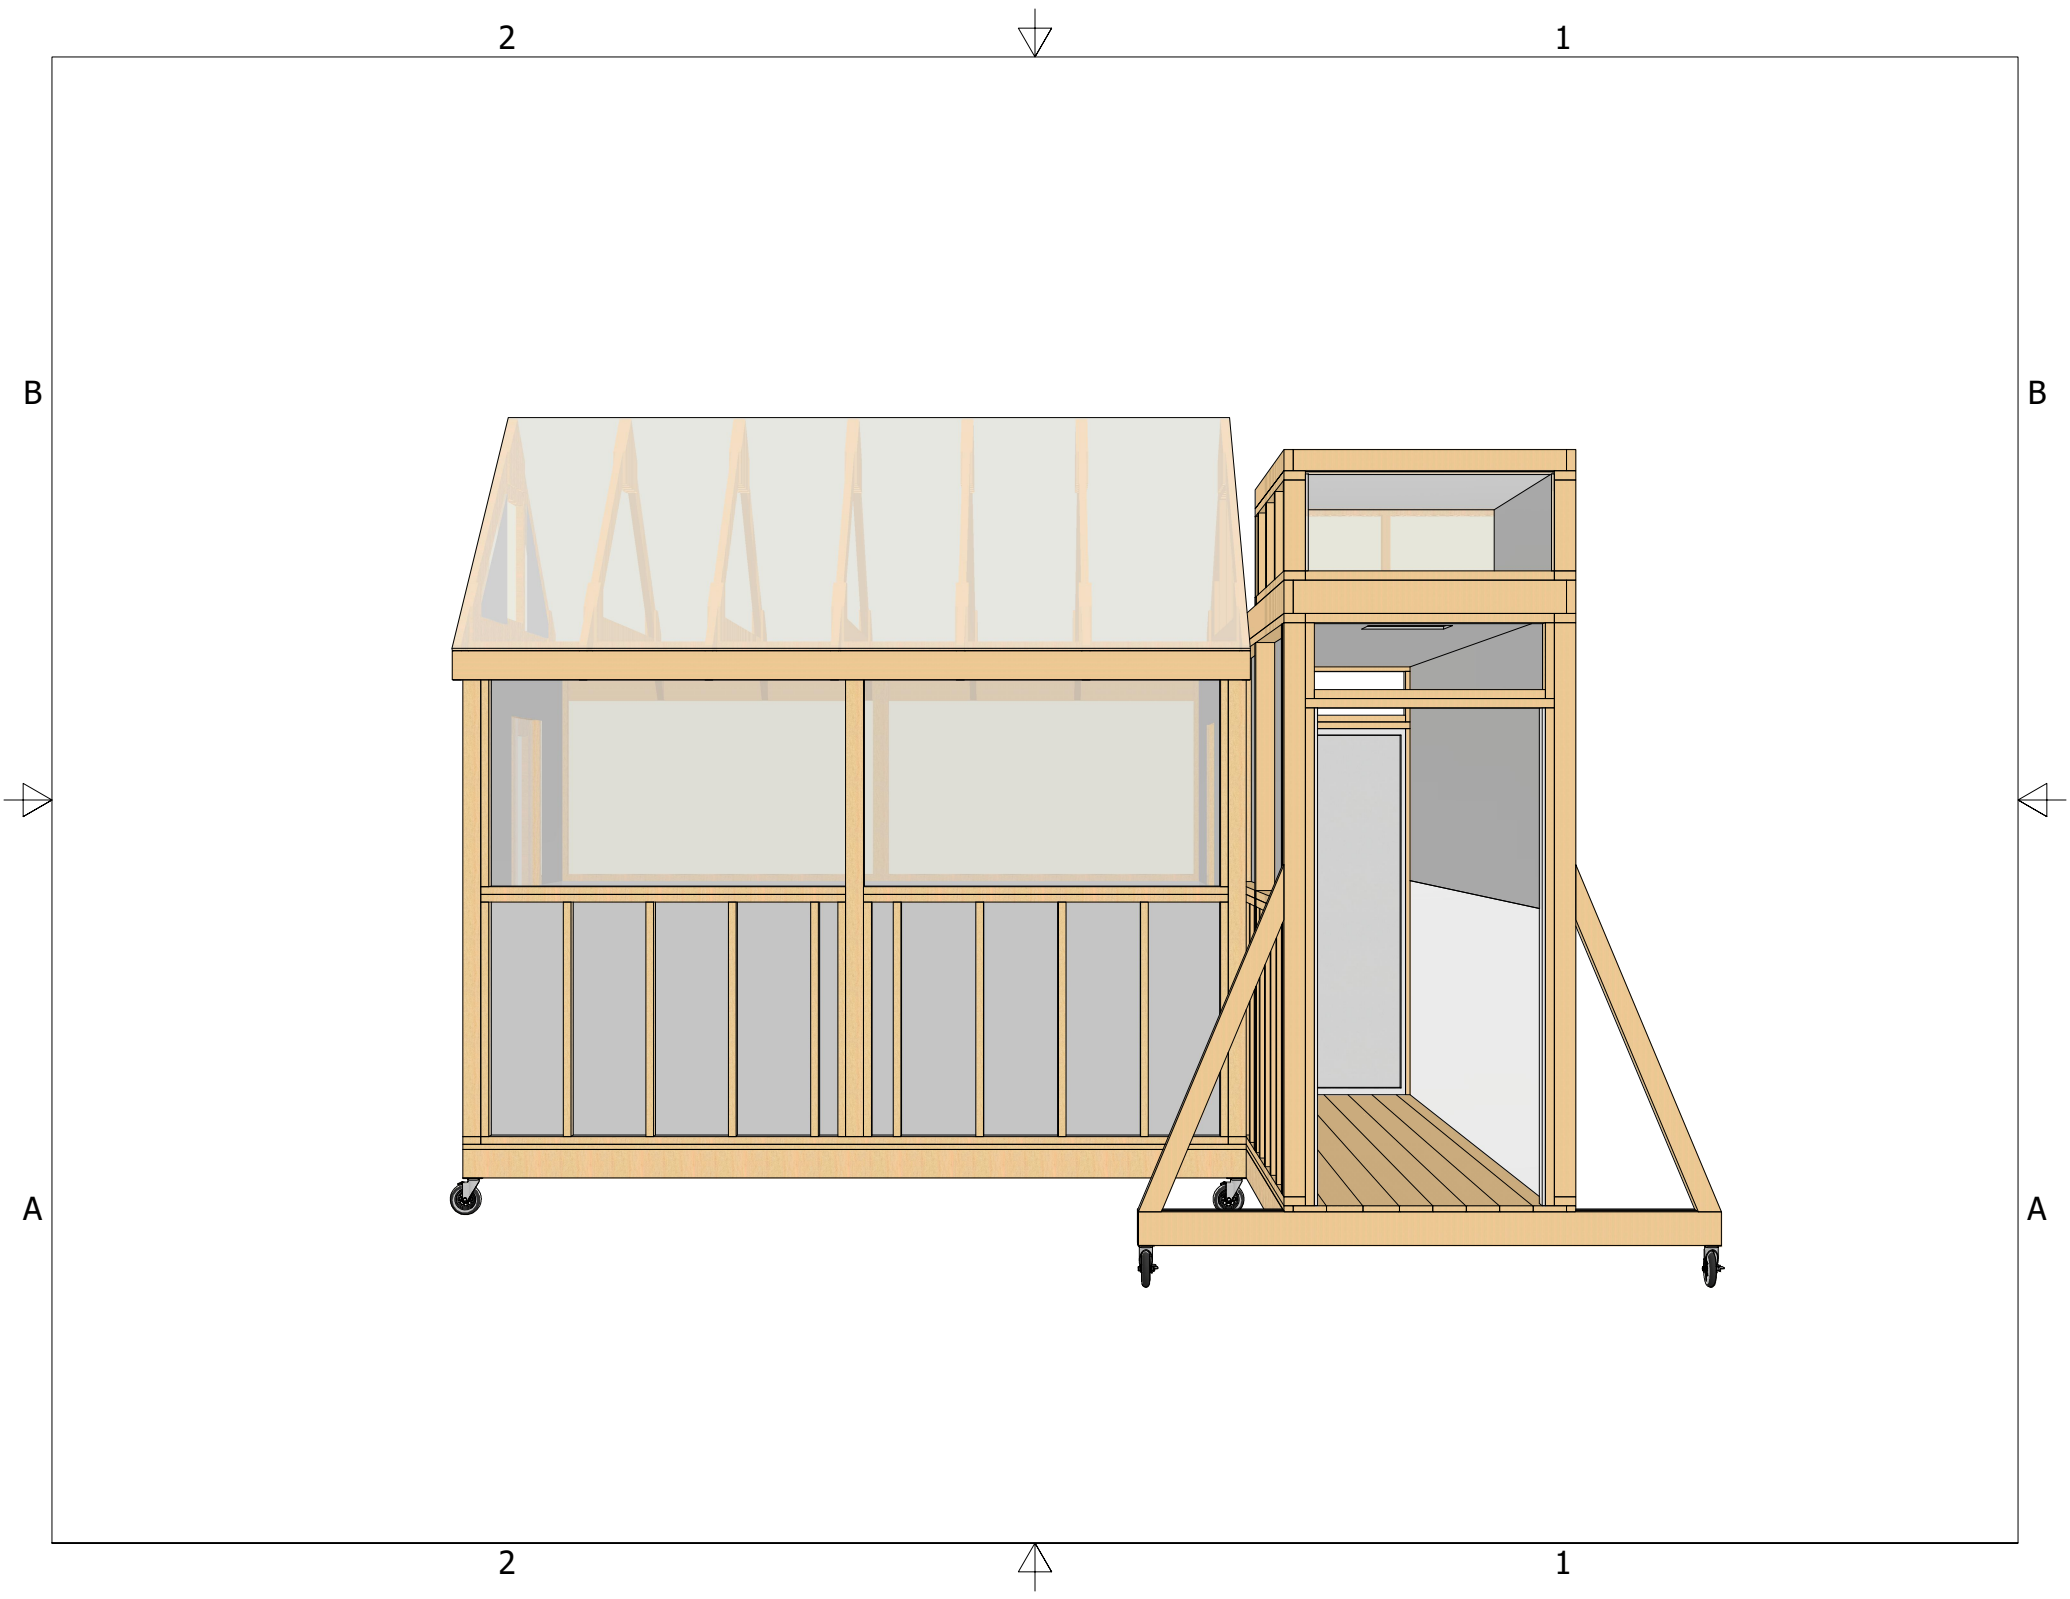

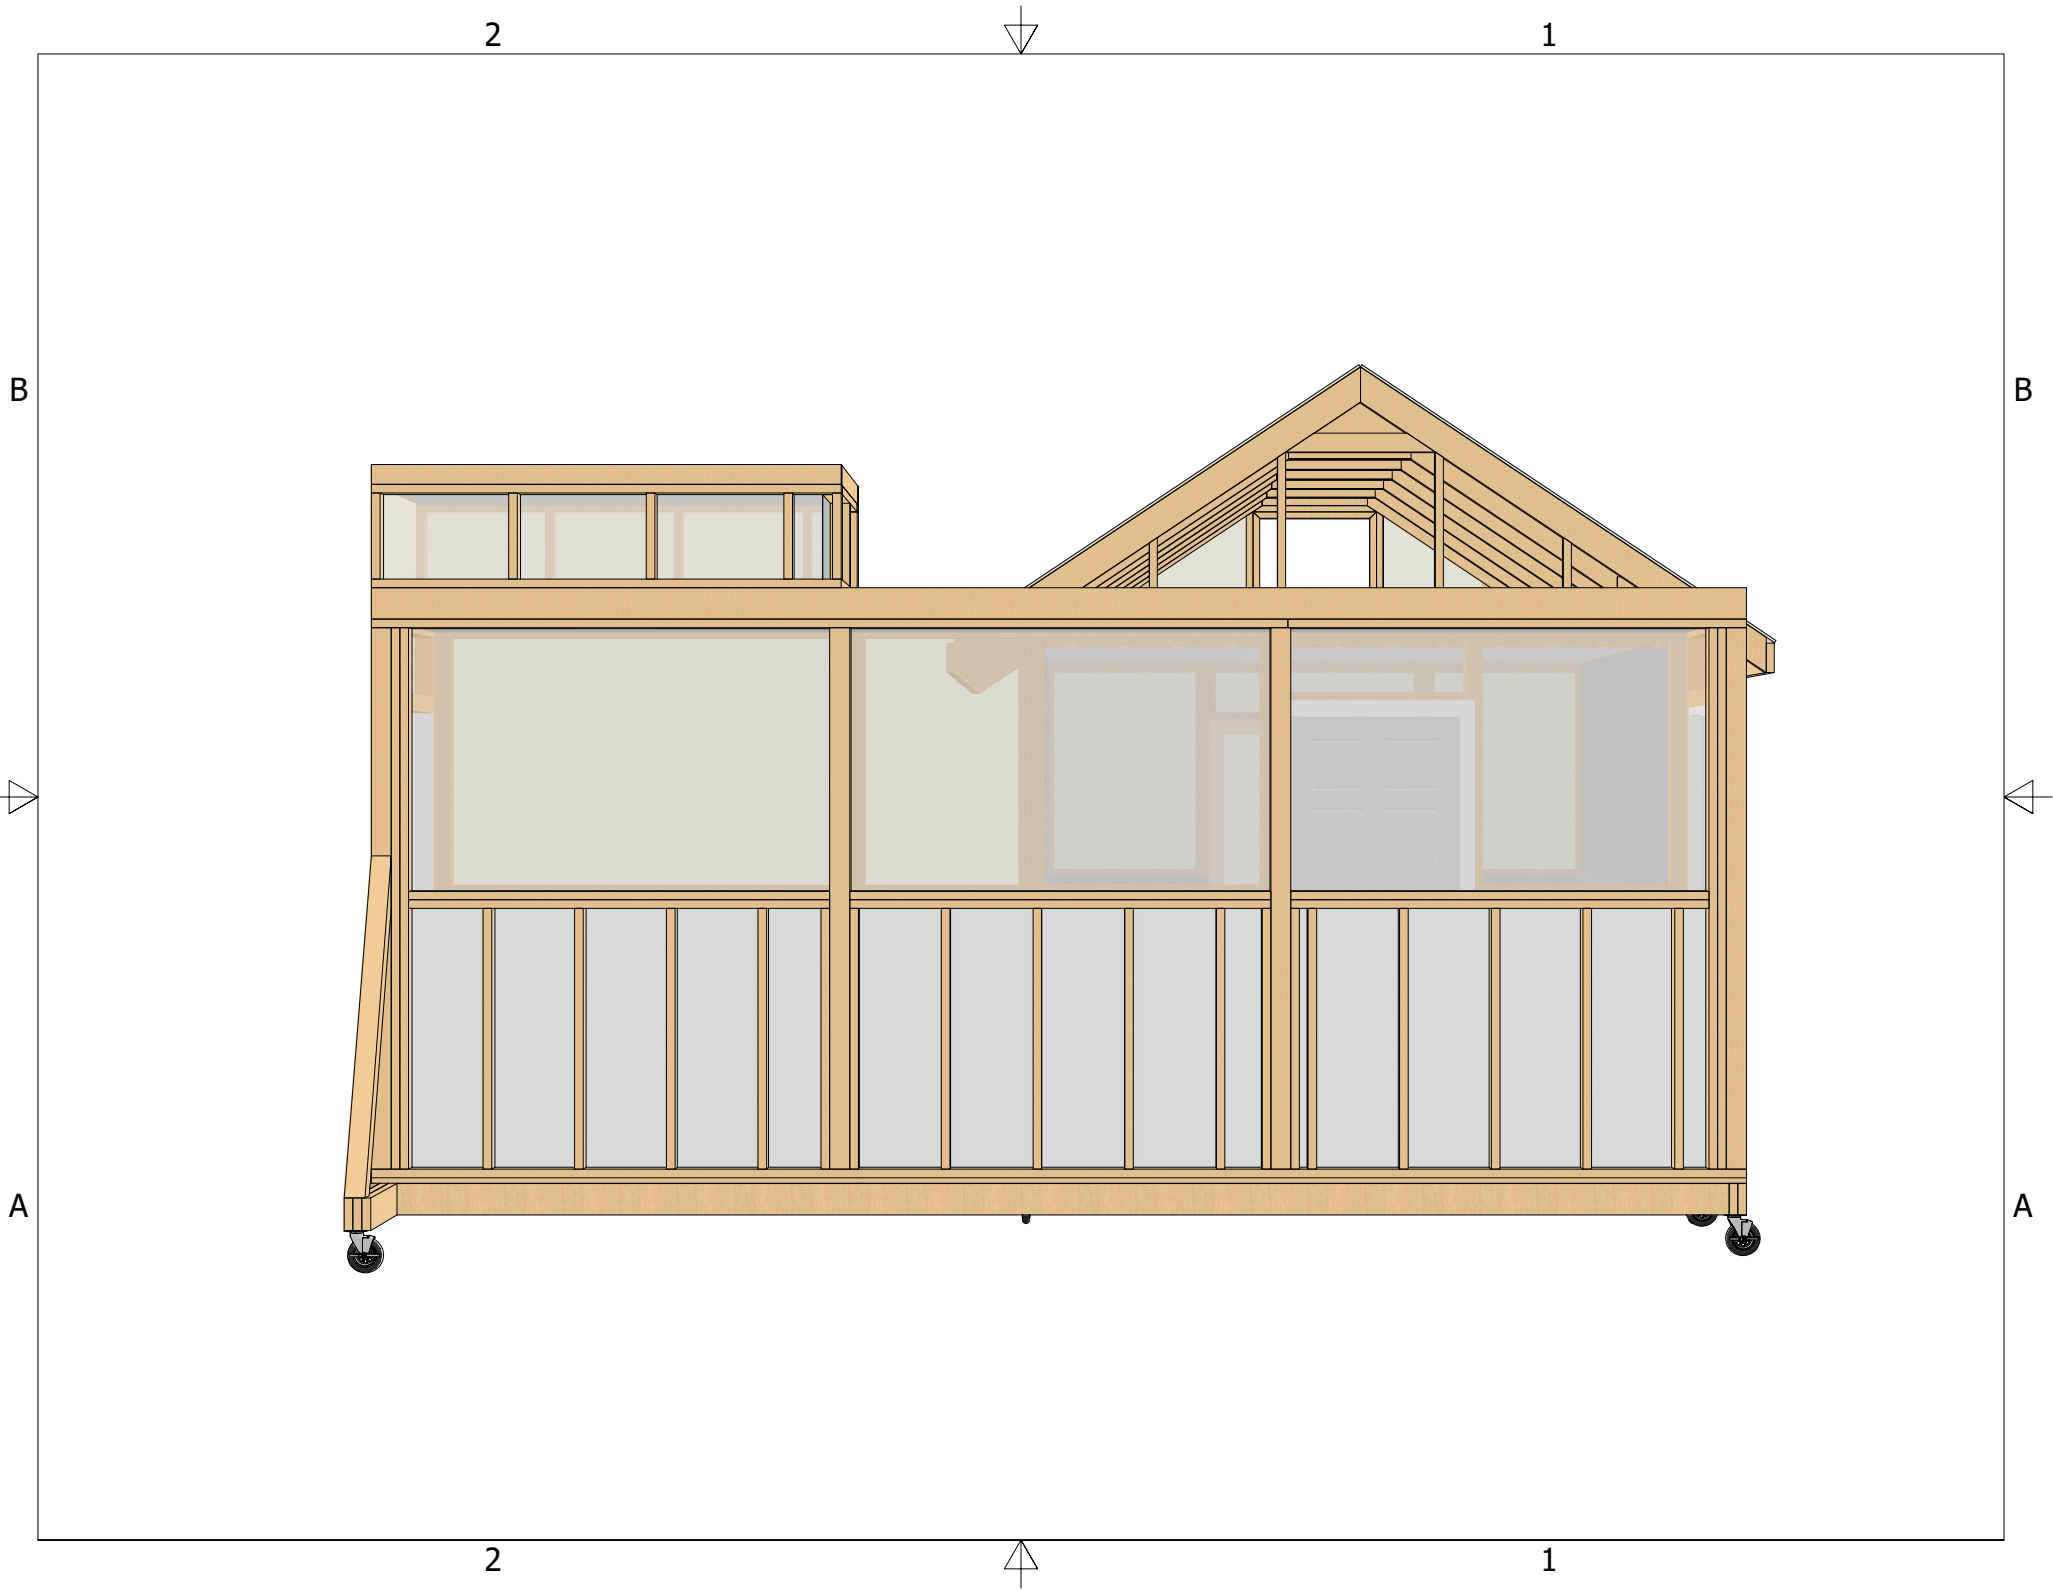

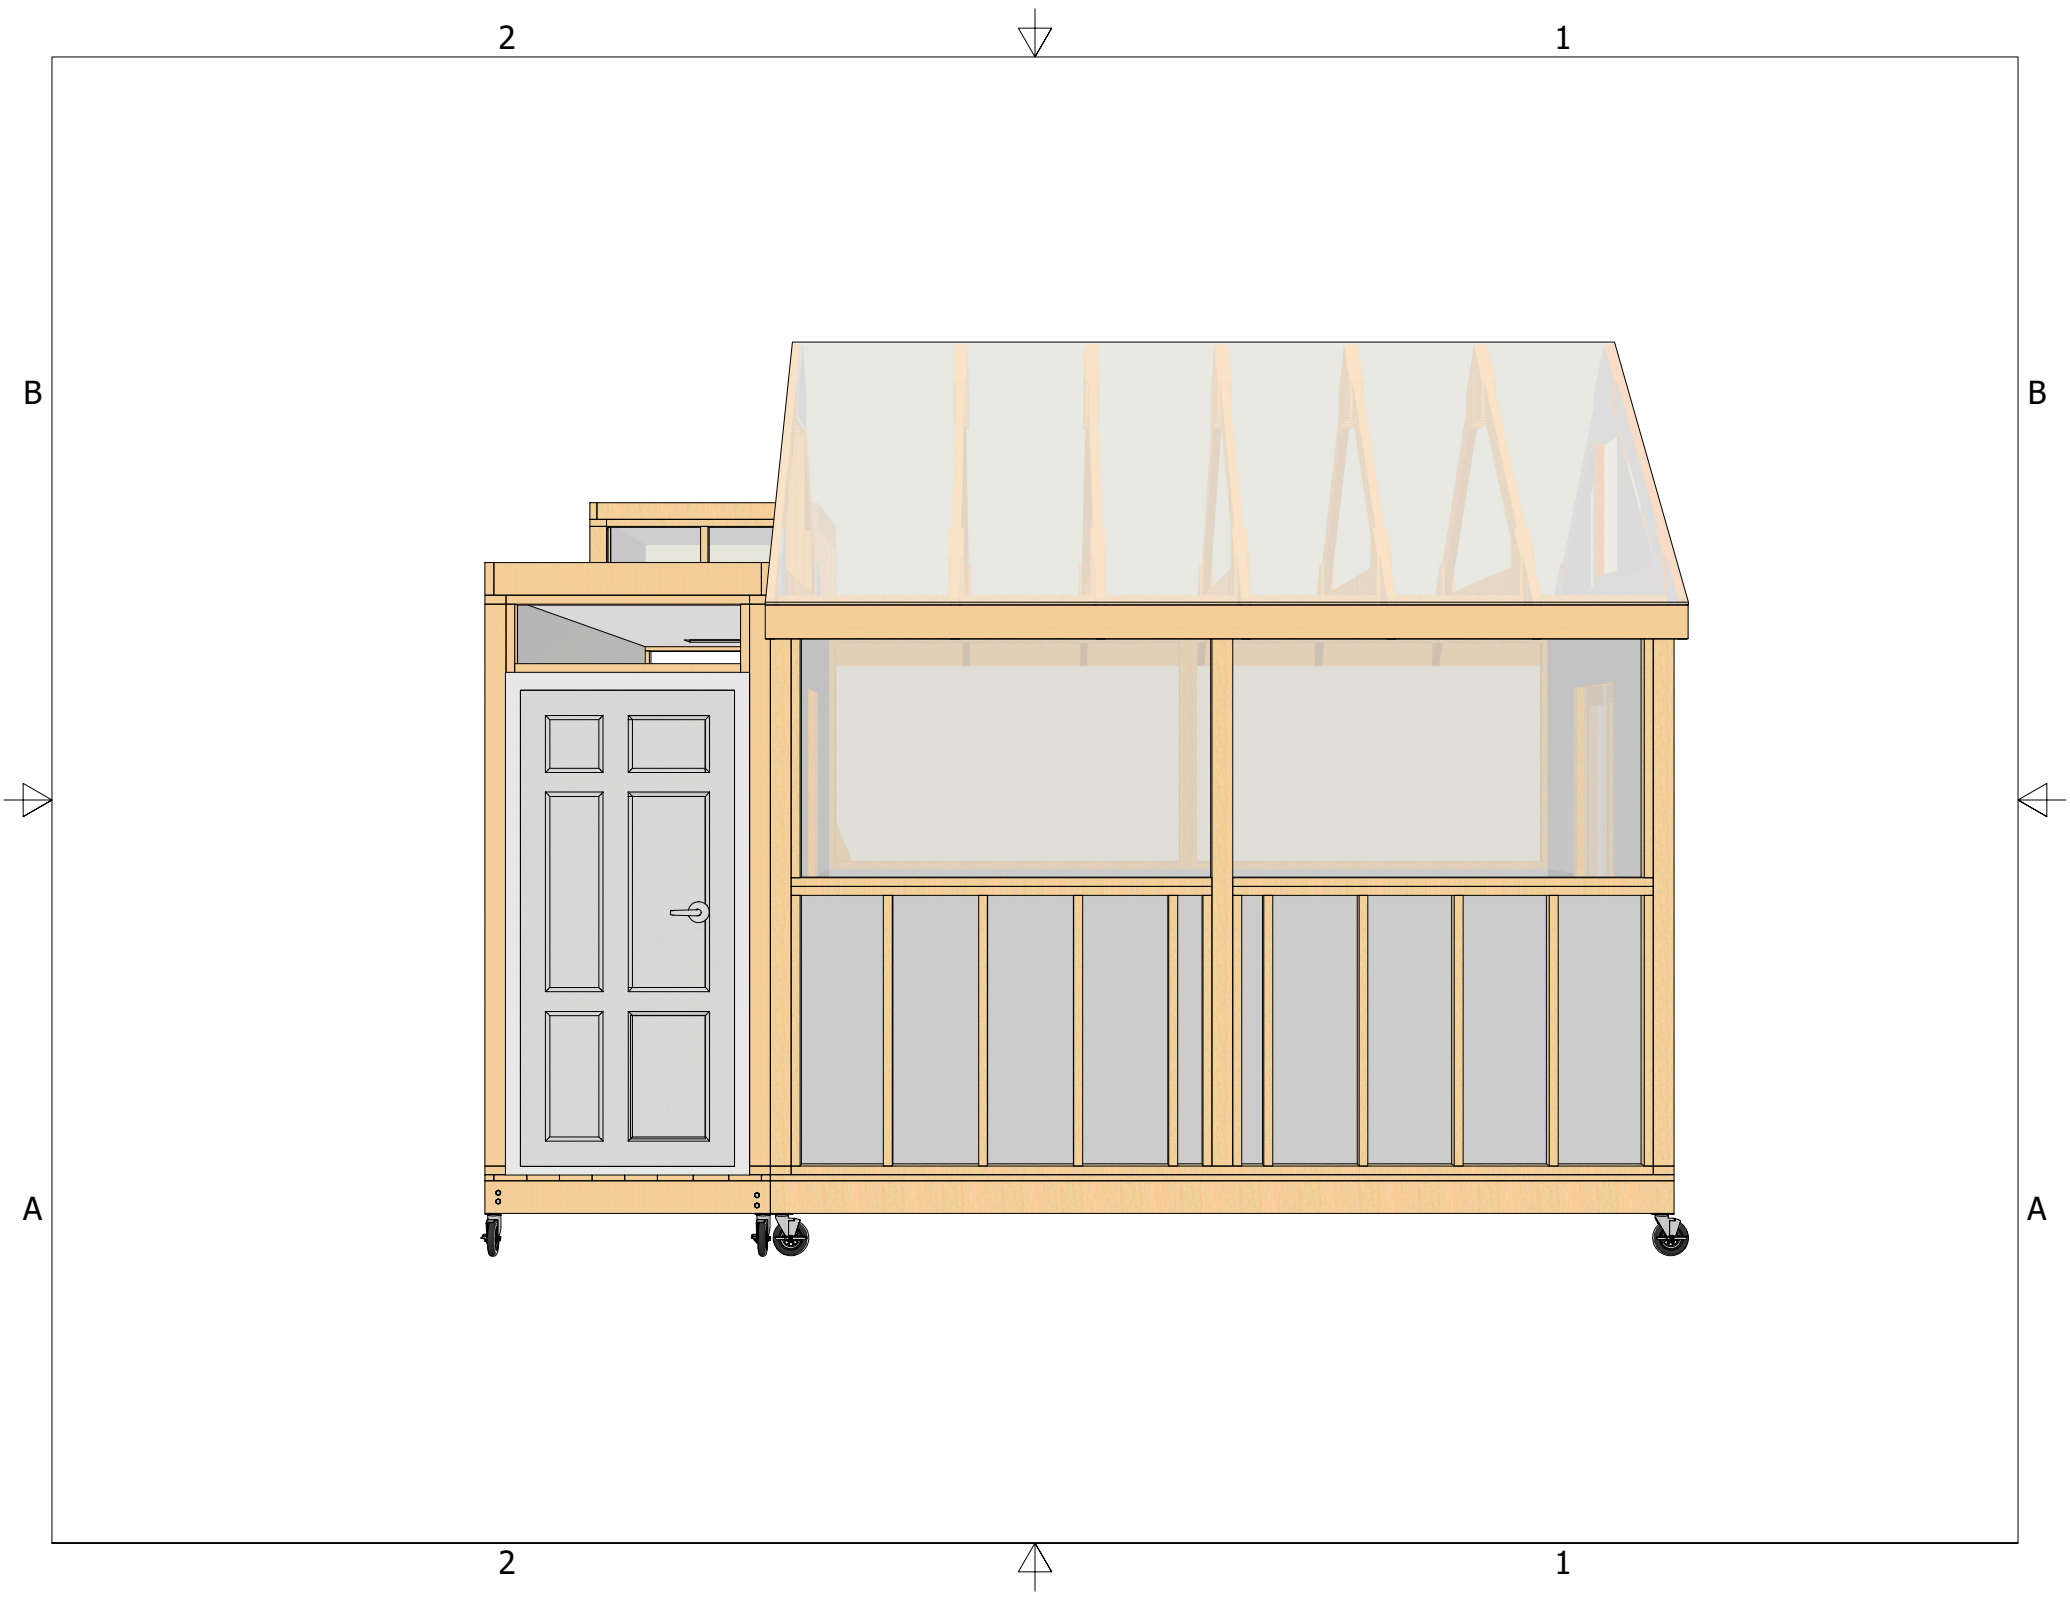

2

1

B

B



A

A

FIRE SAFETY RESEARCH INSTITUTE





Research
Institutes


HOSE STREAM PROP
ROOM DRAWINGS


2


1

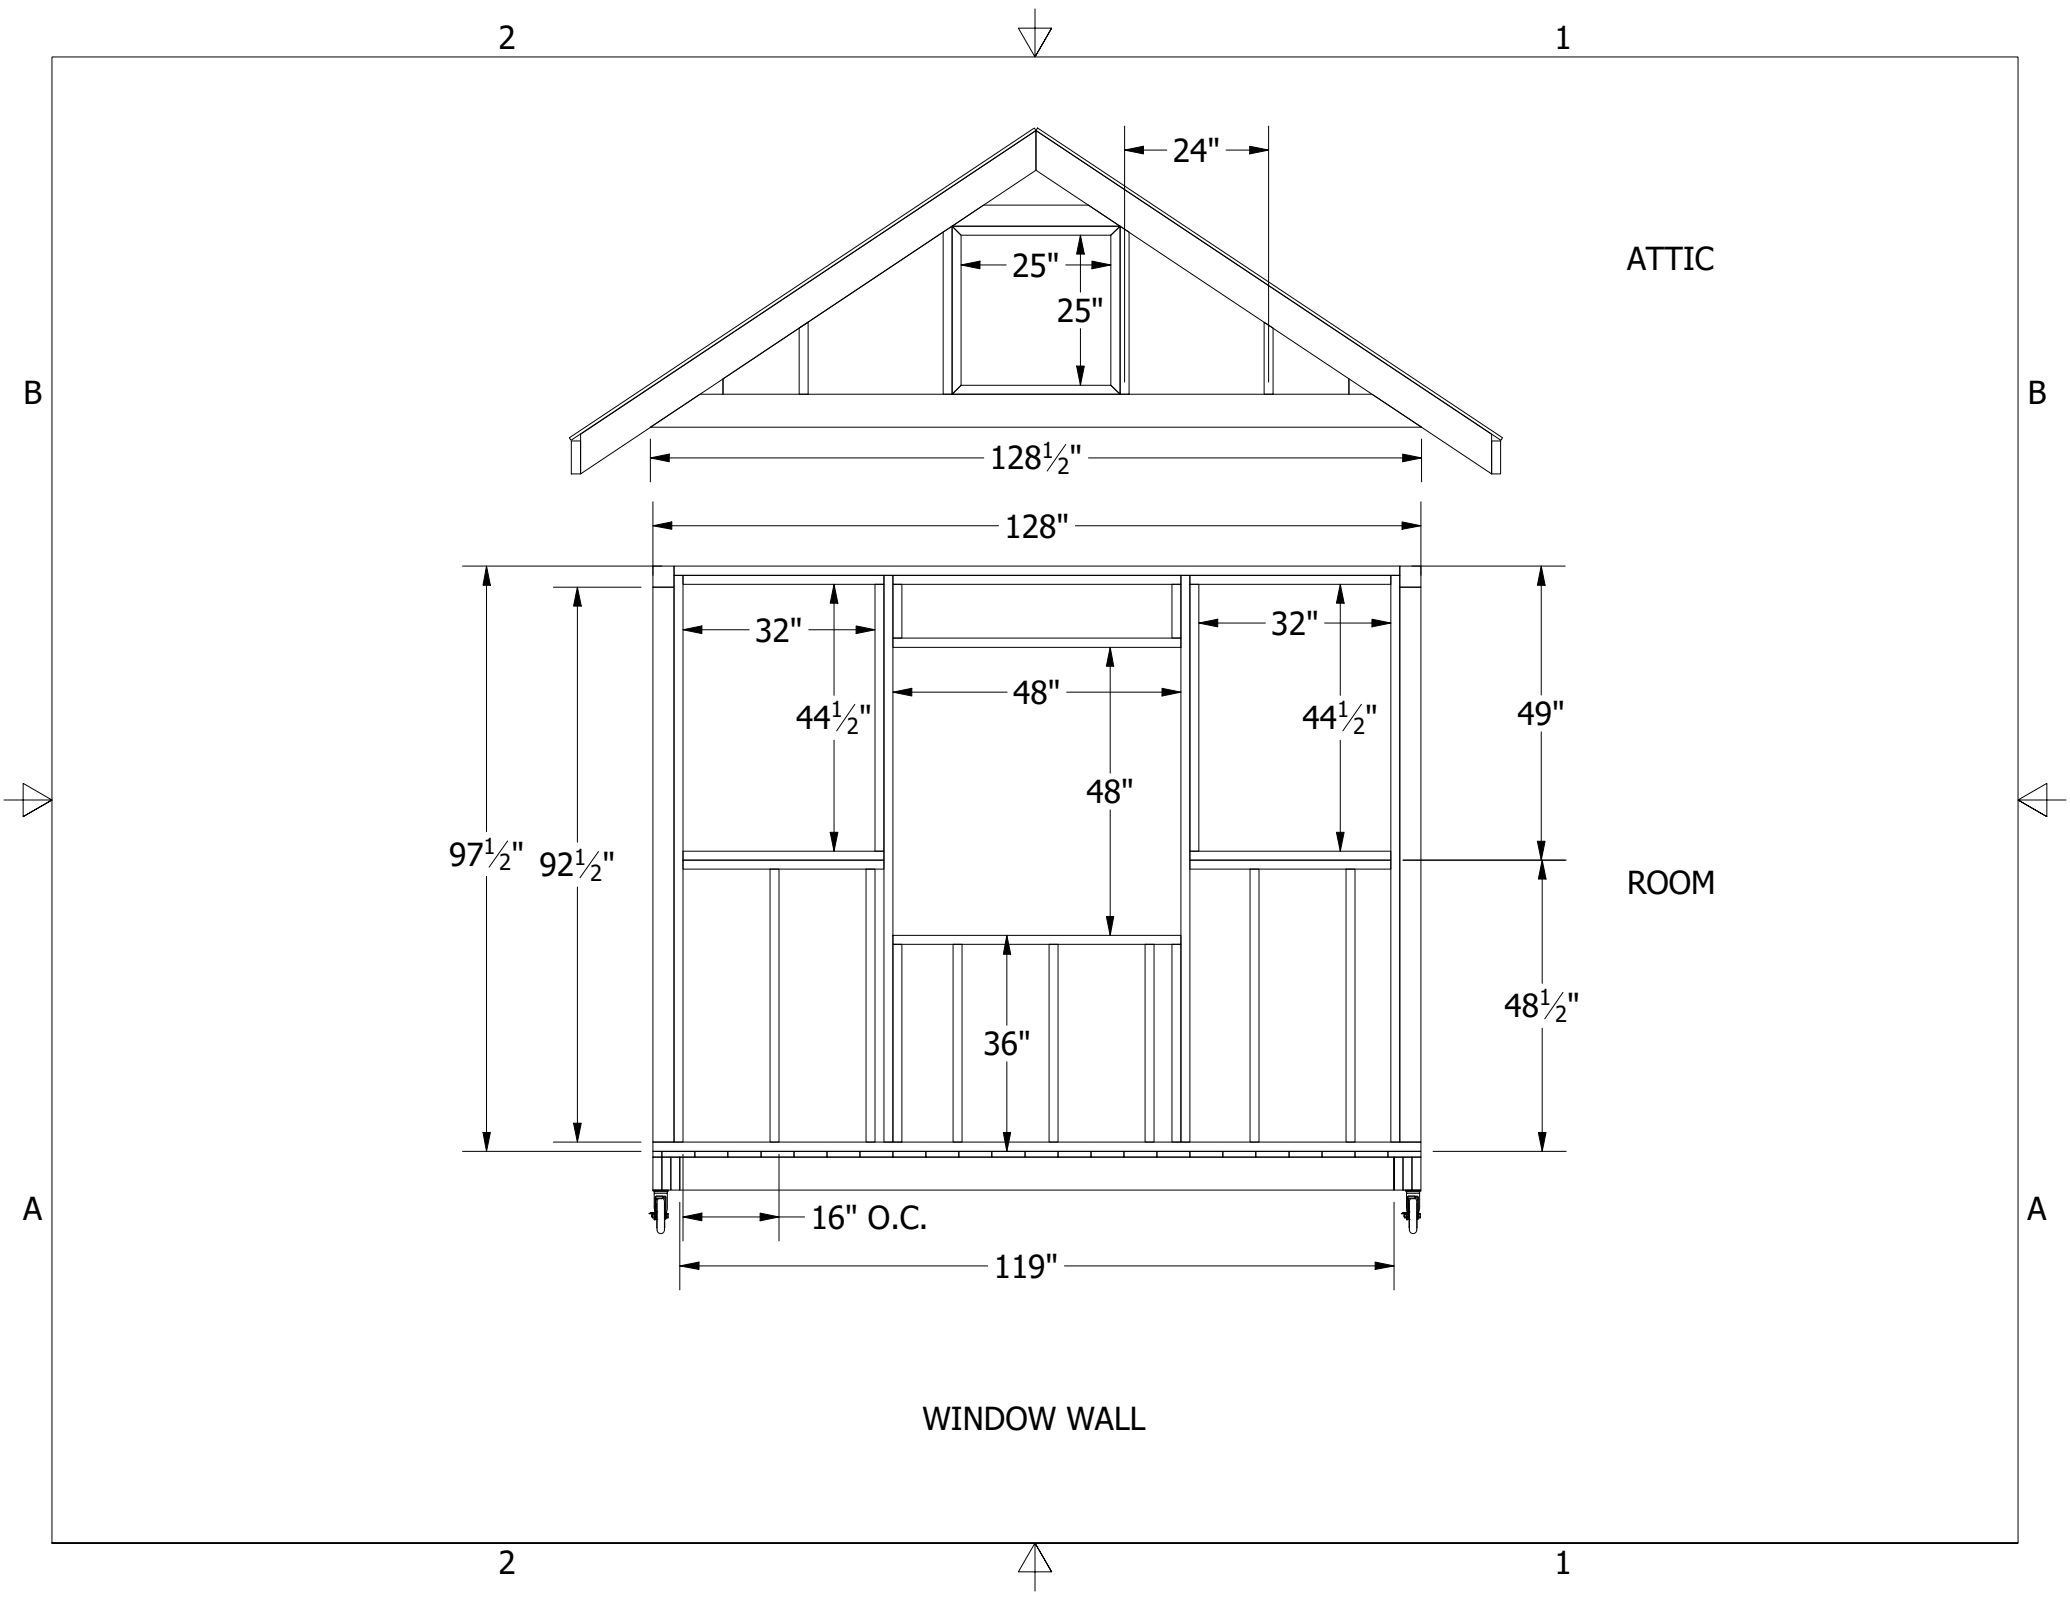


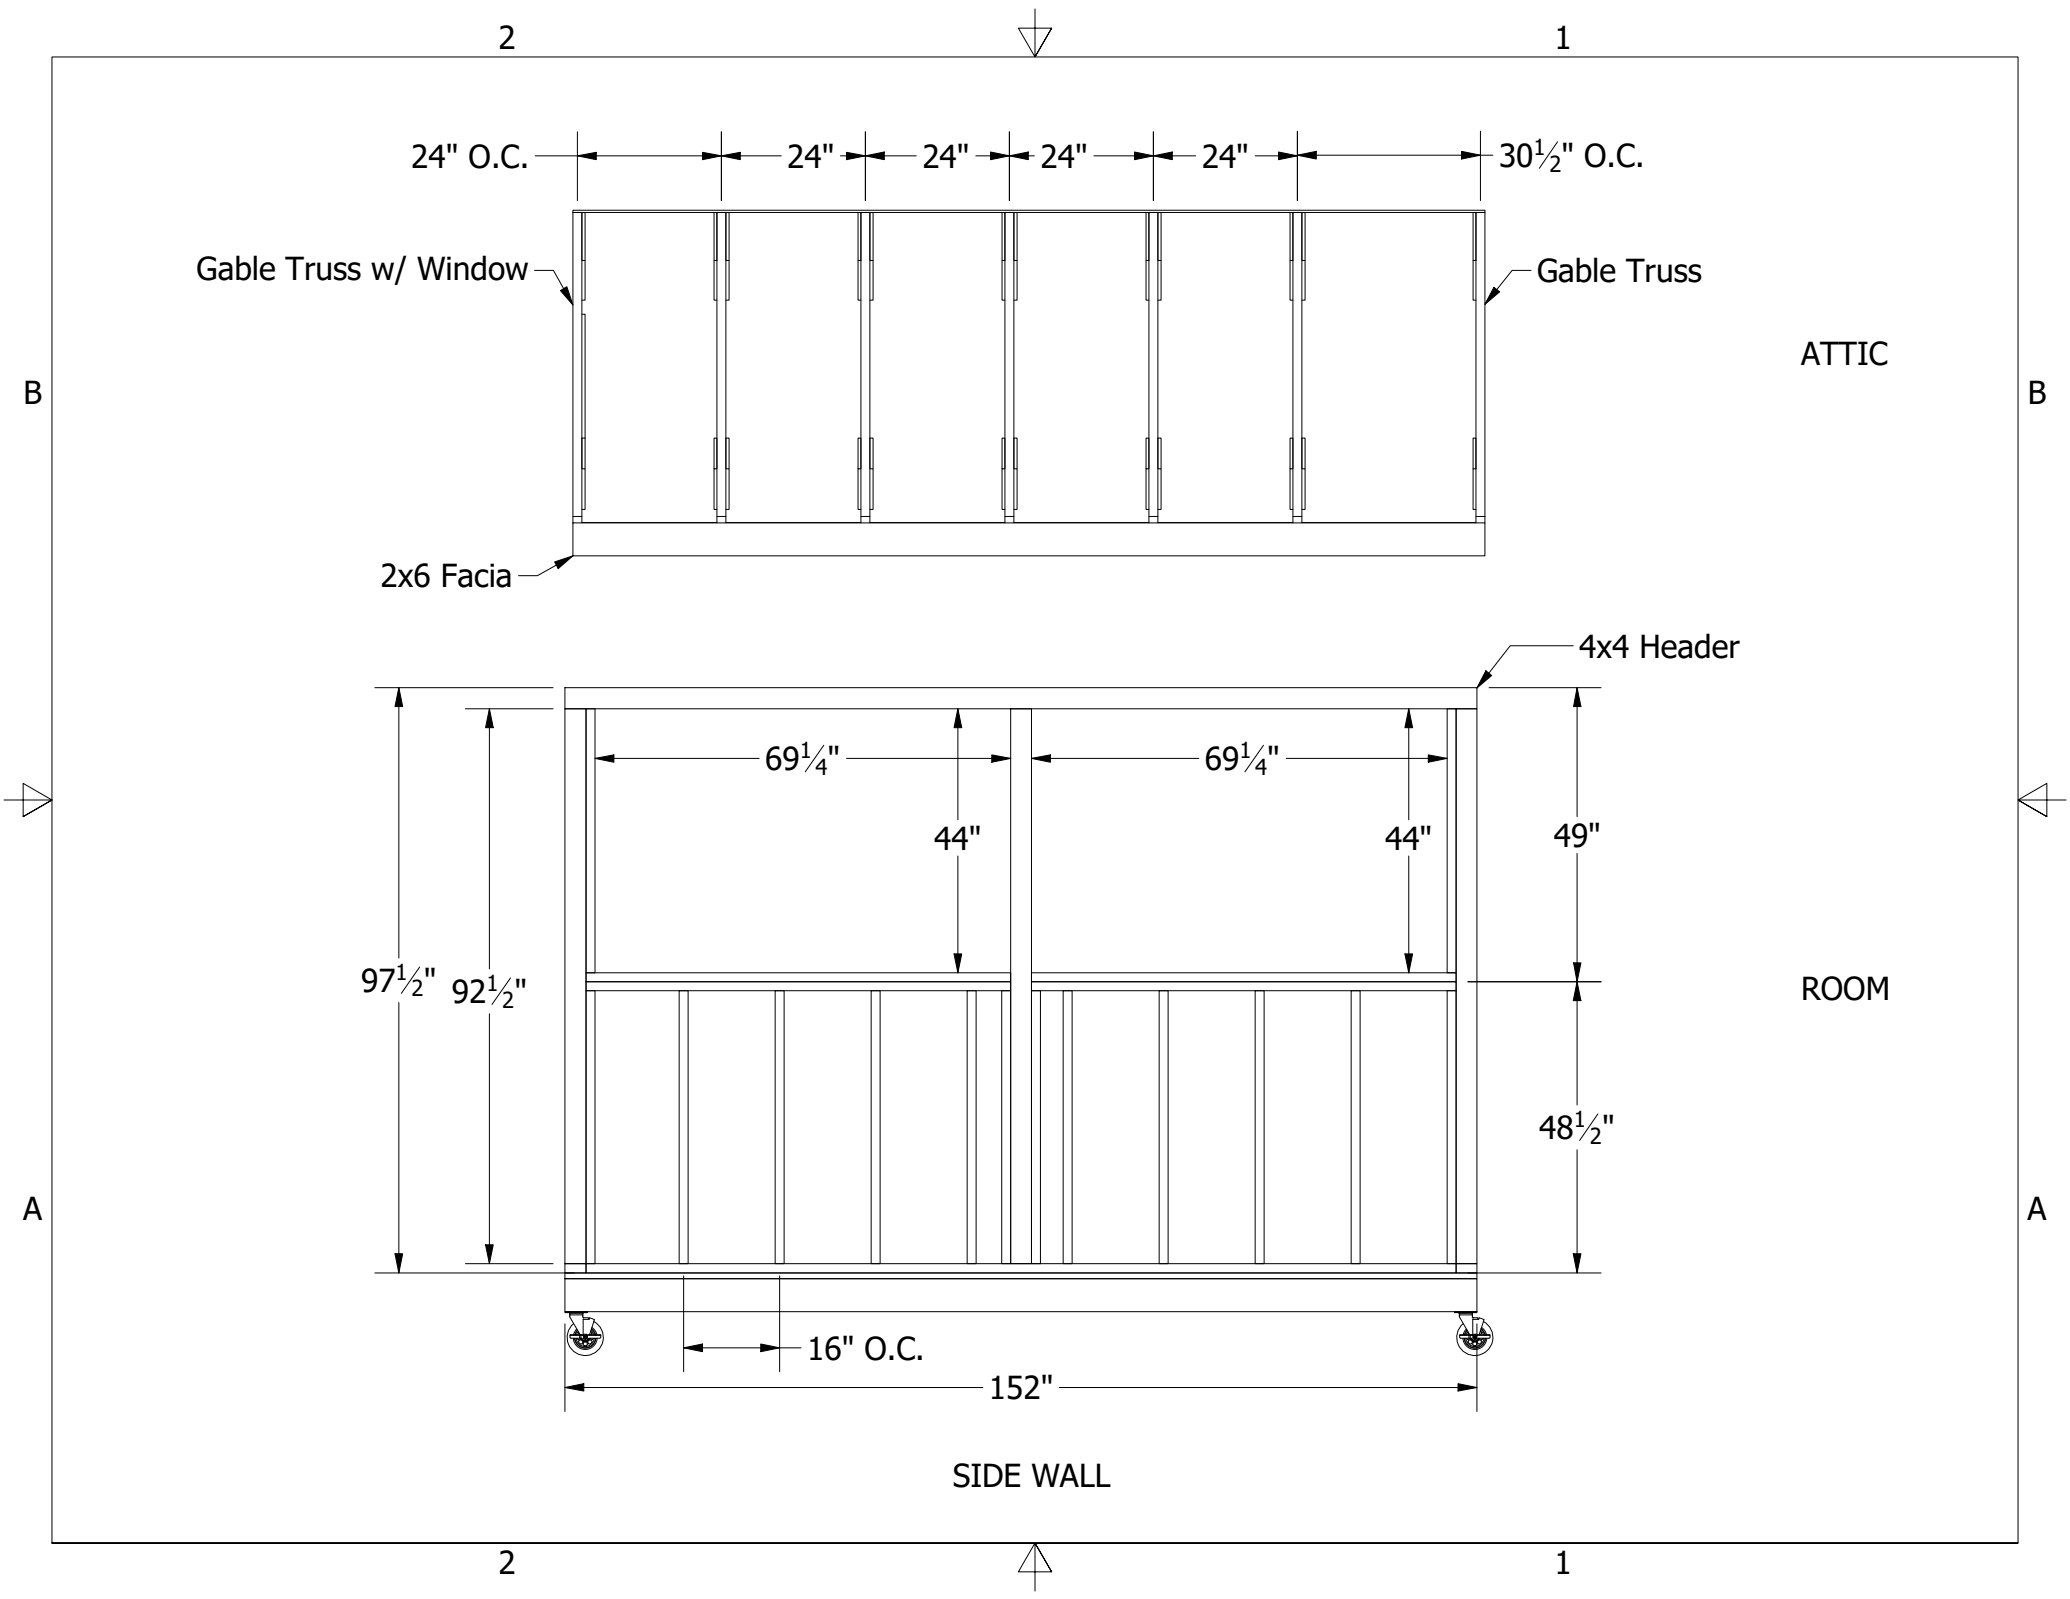


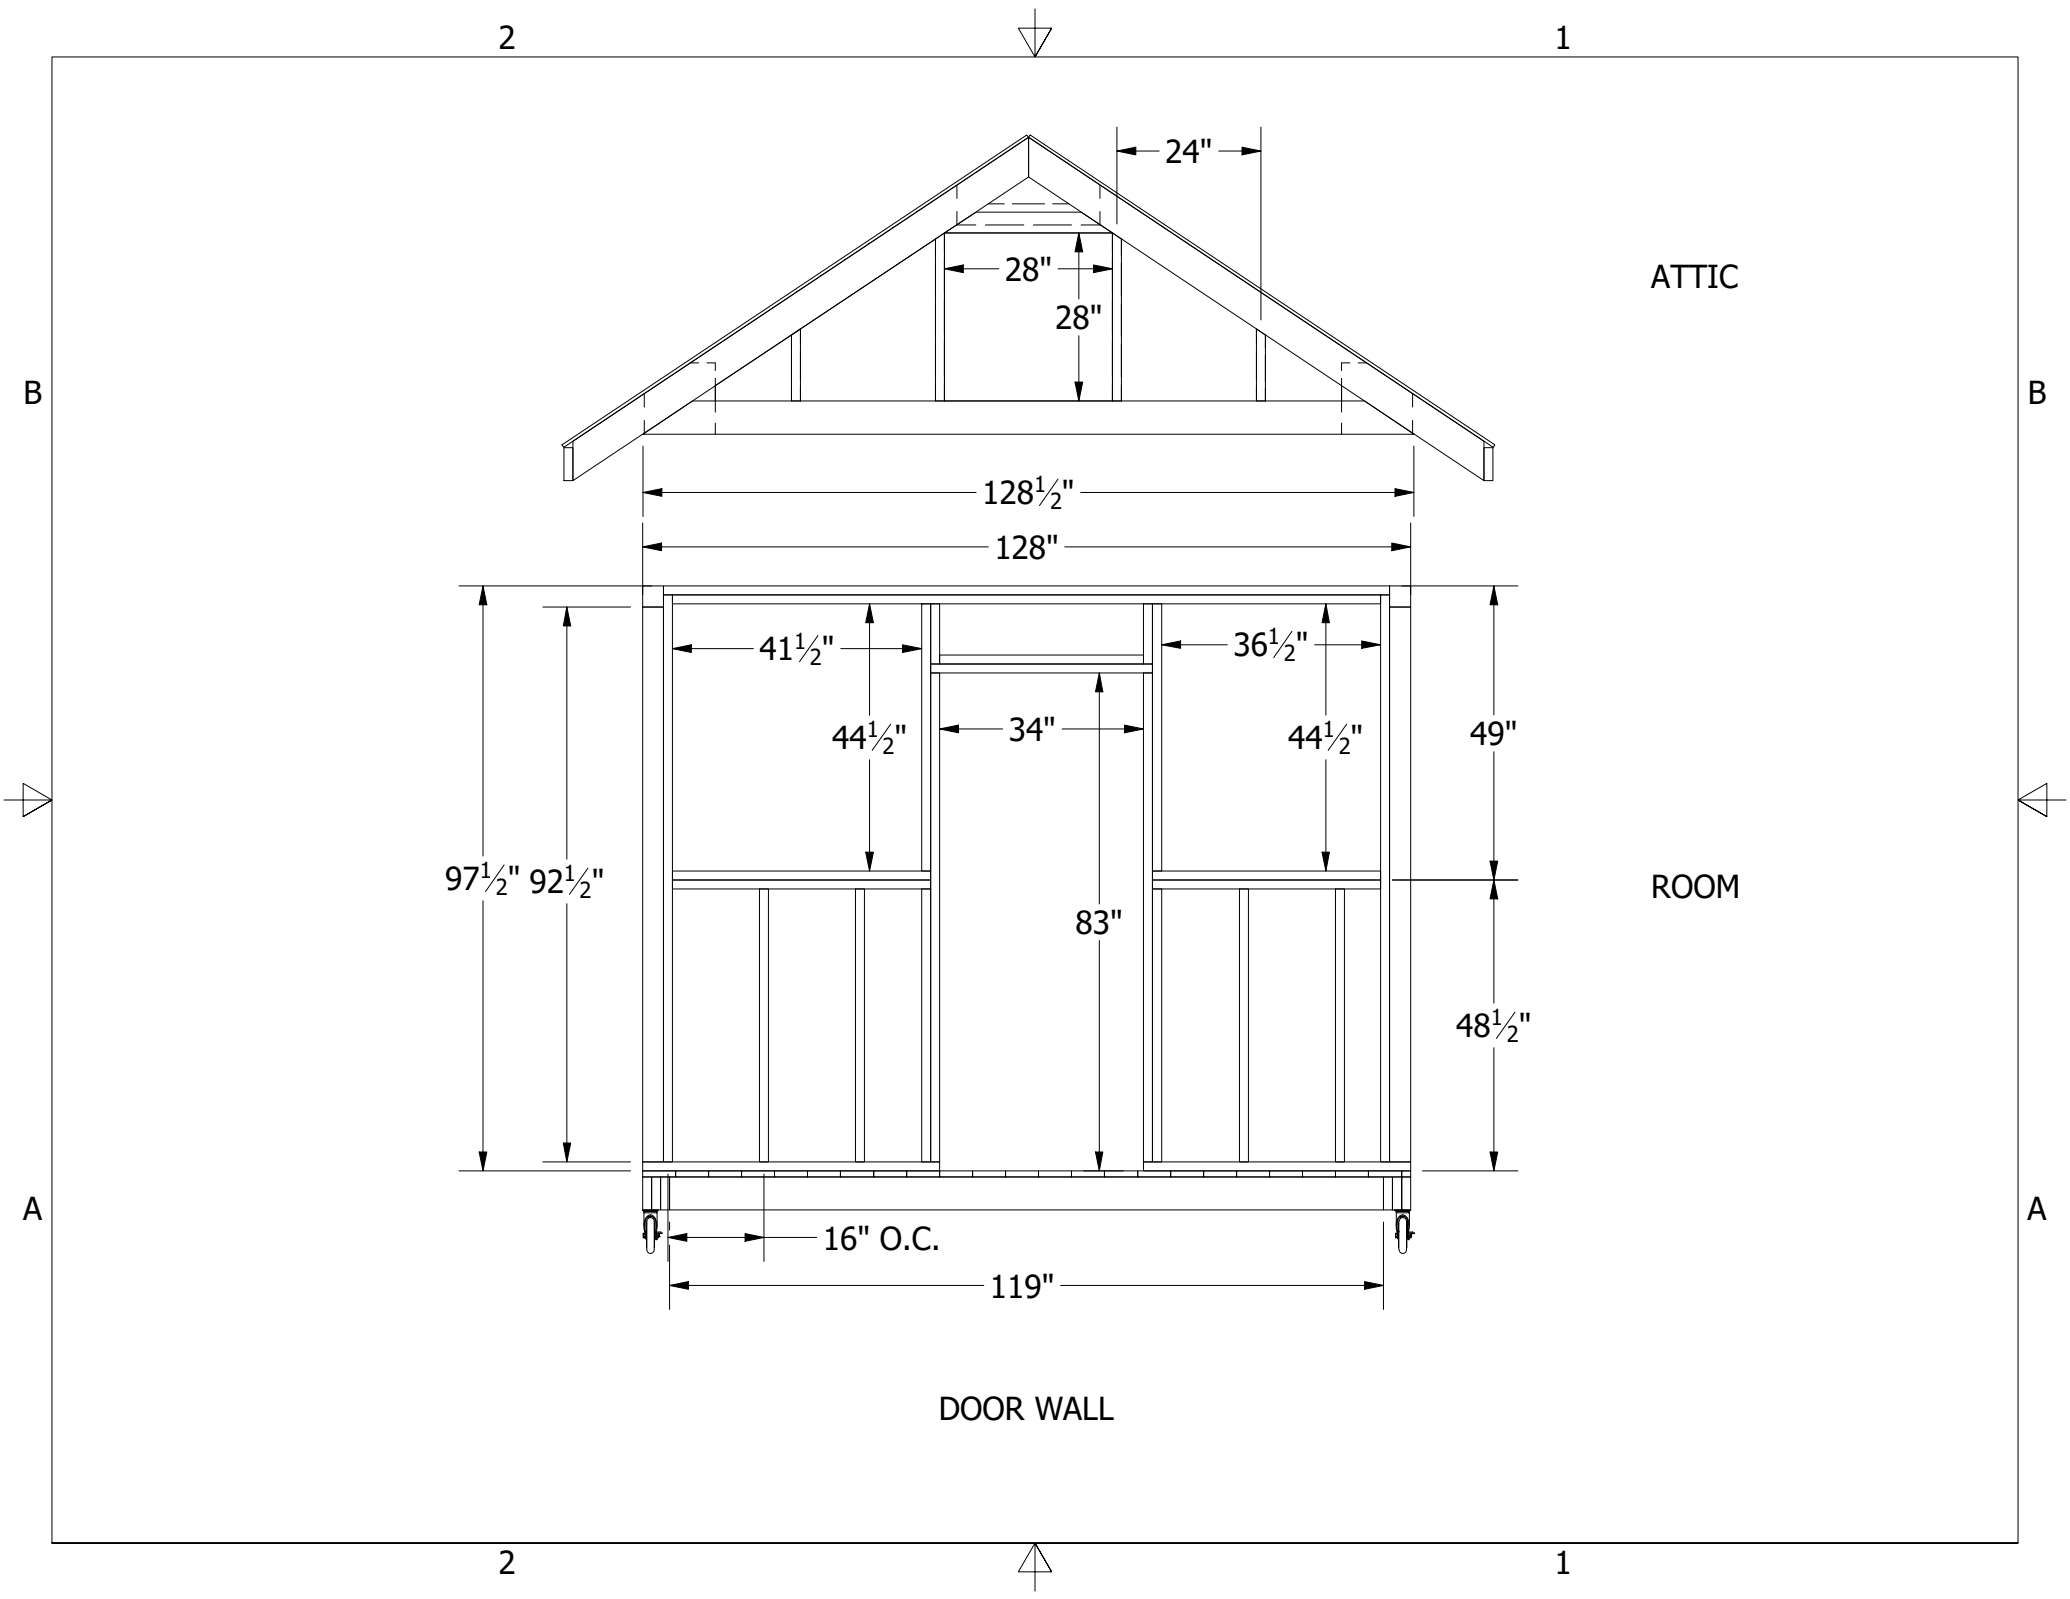


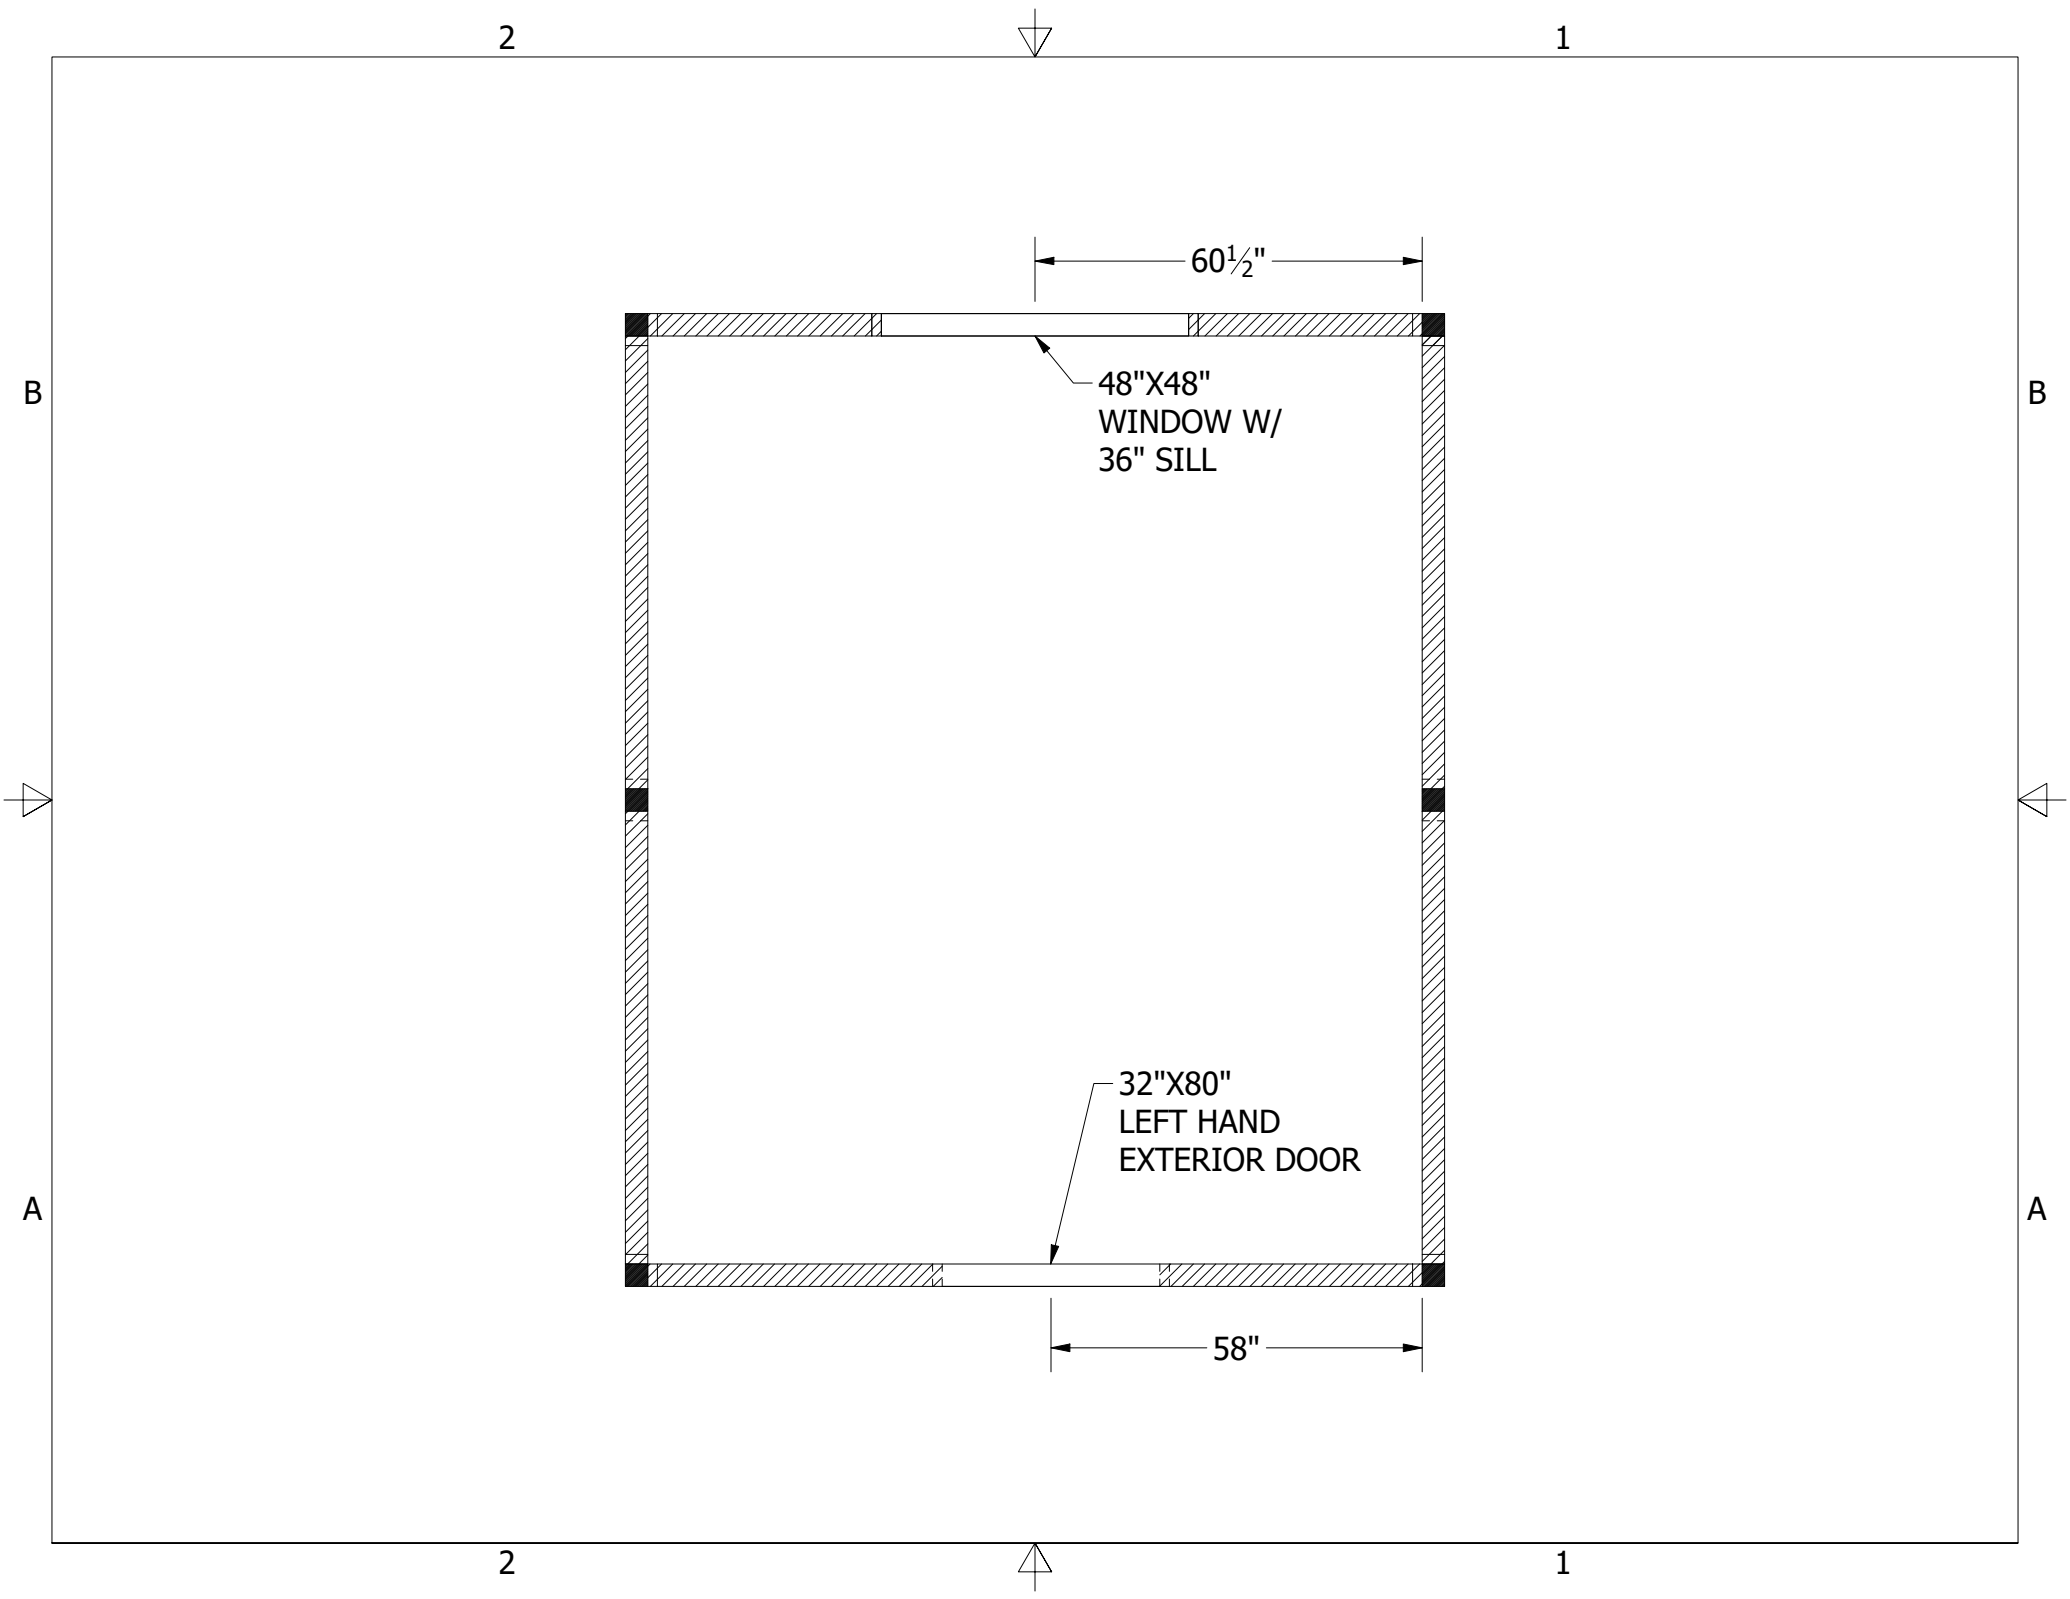


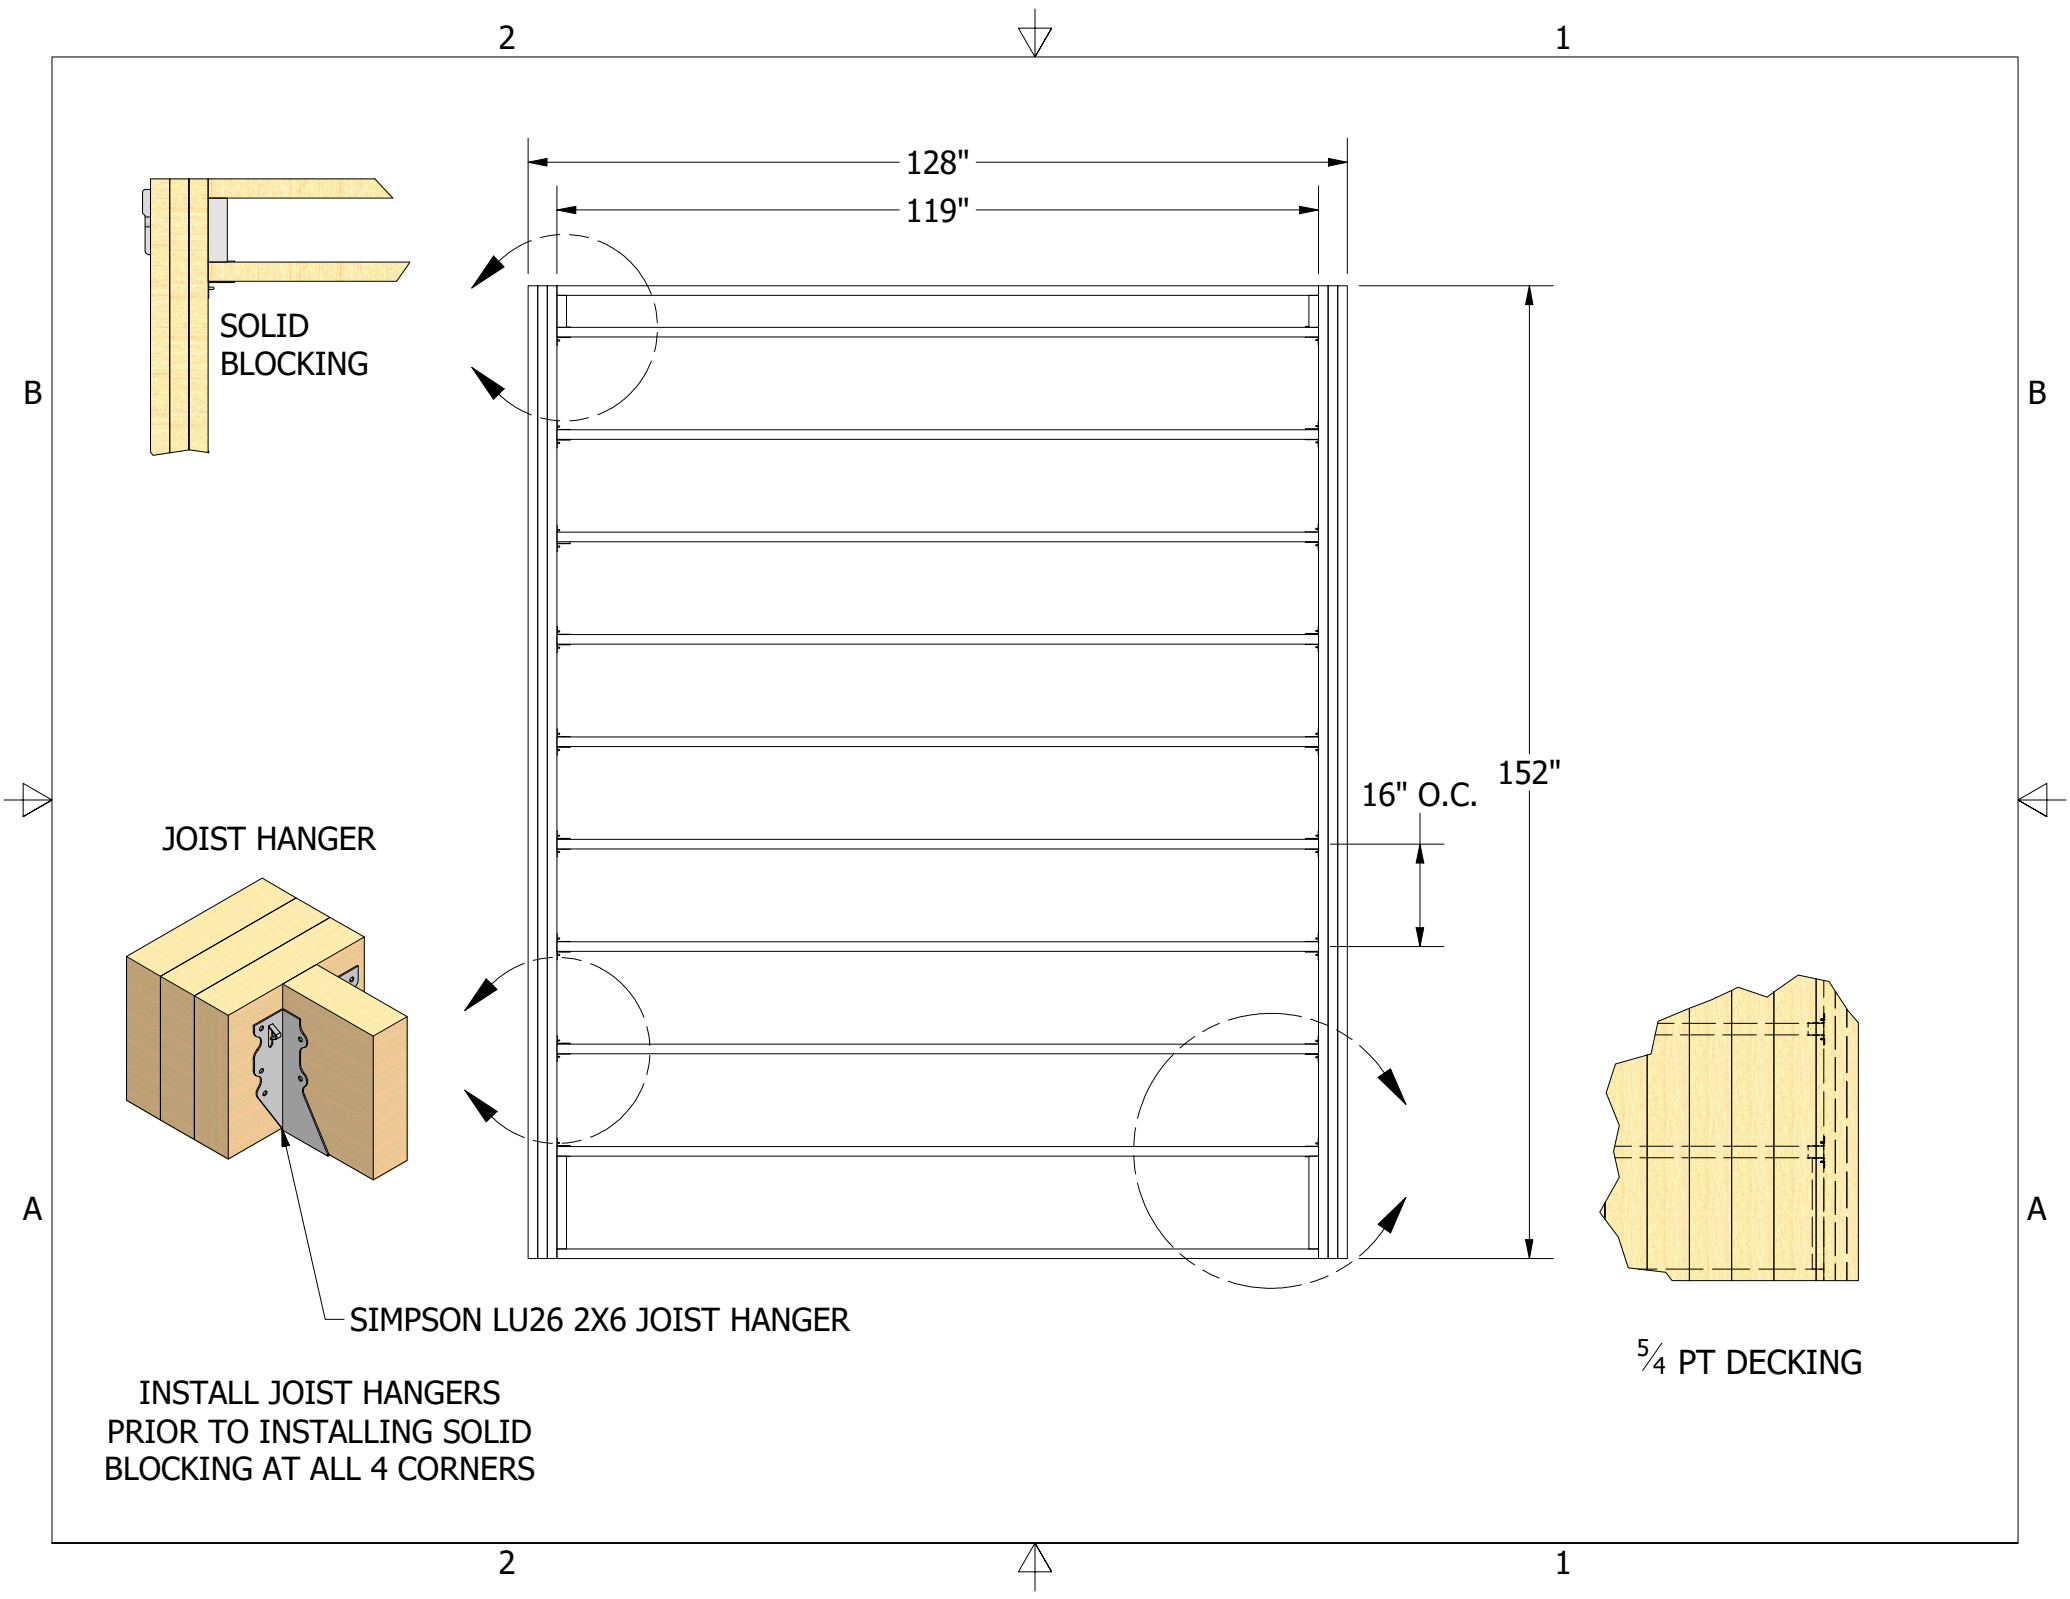


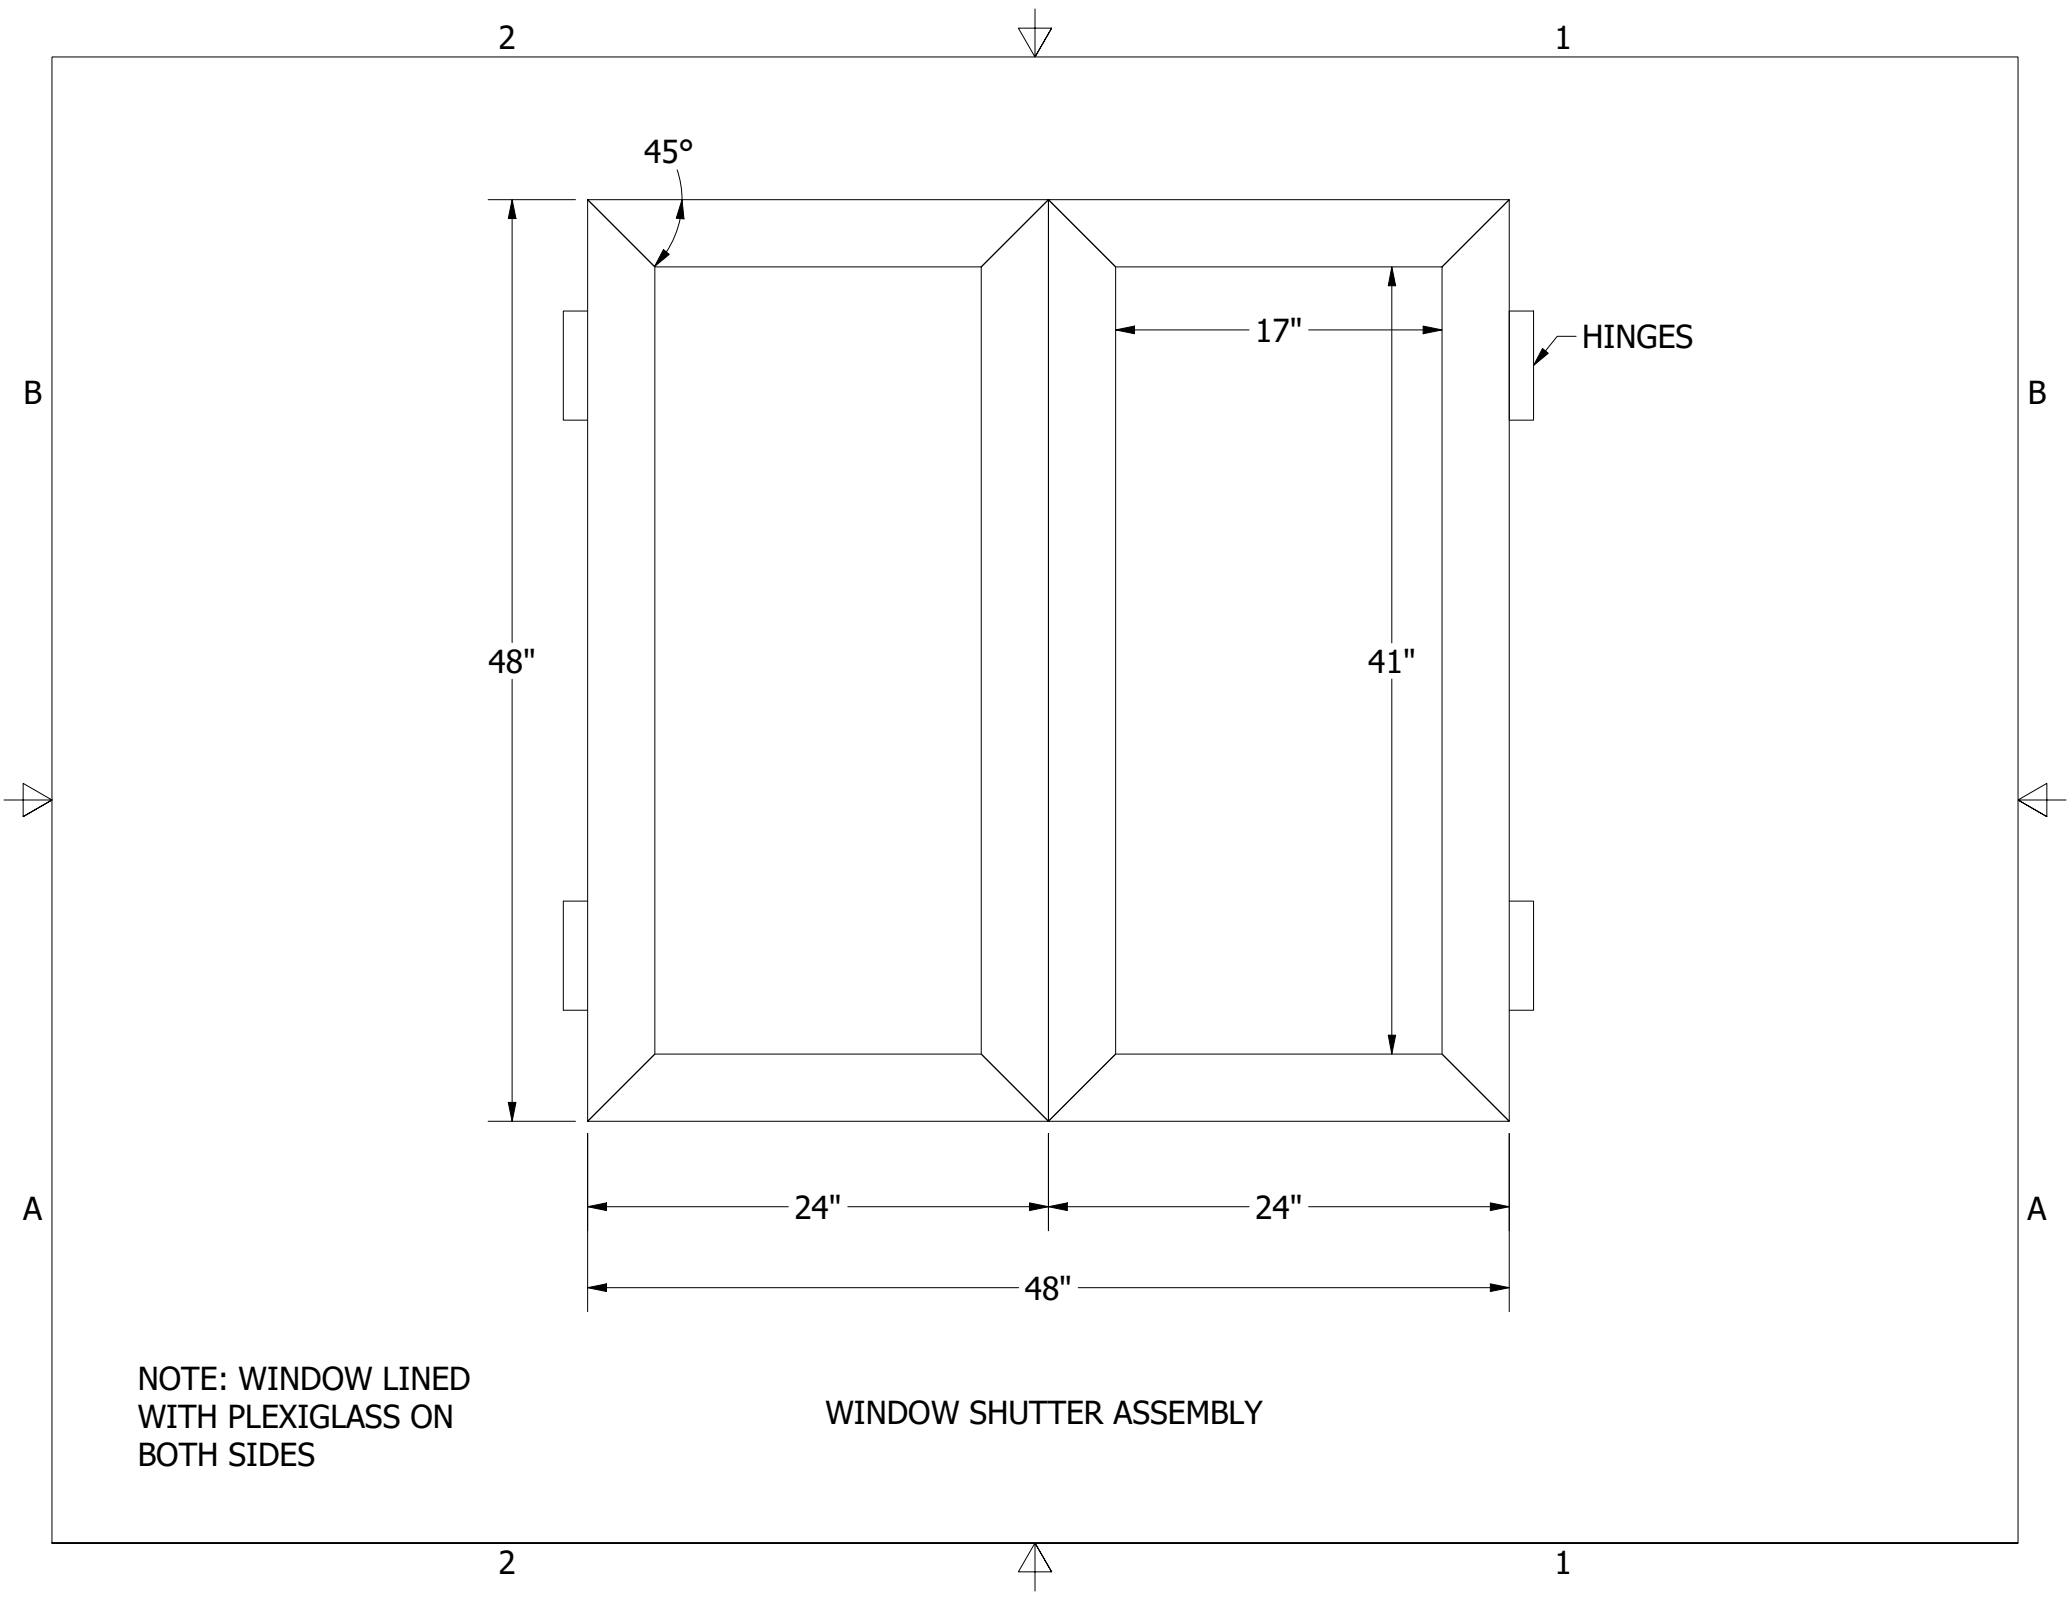


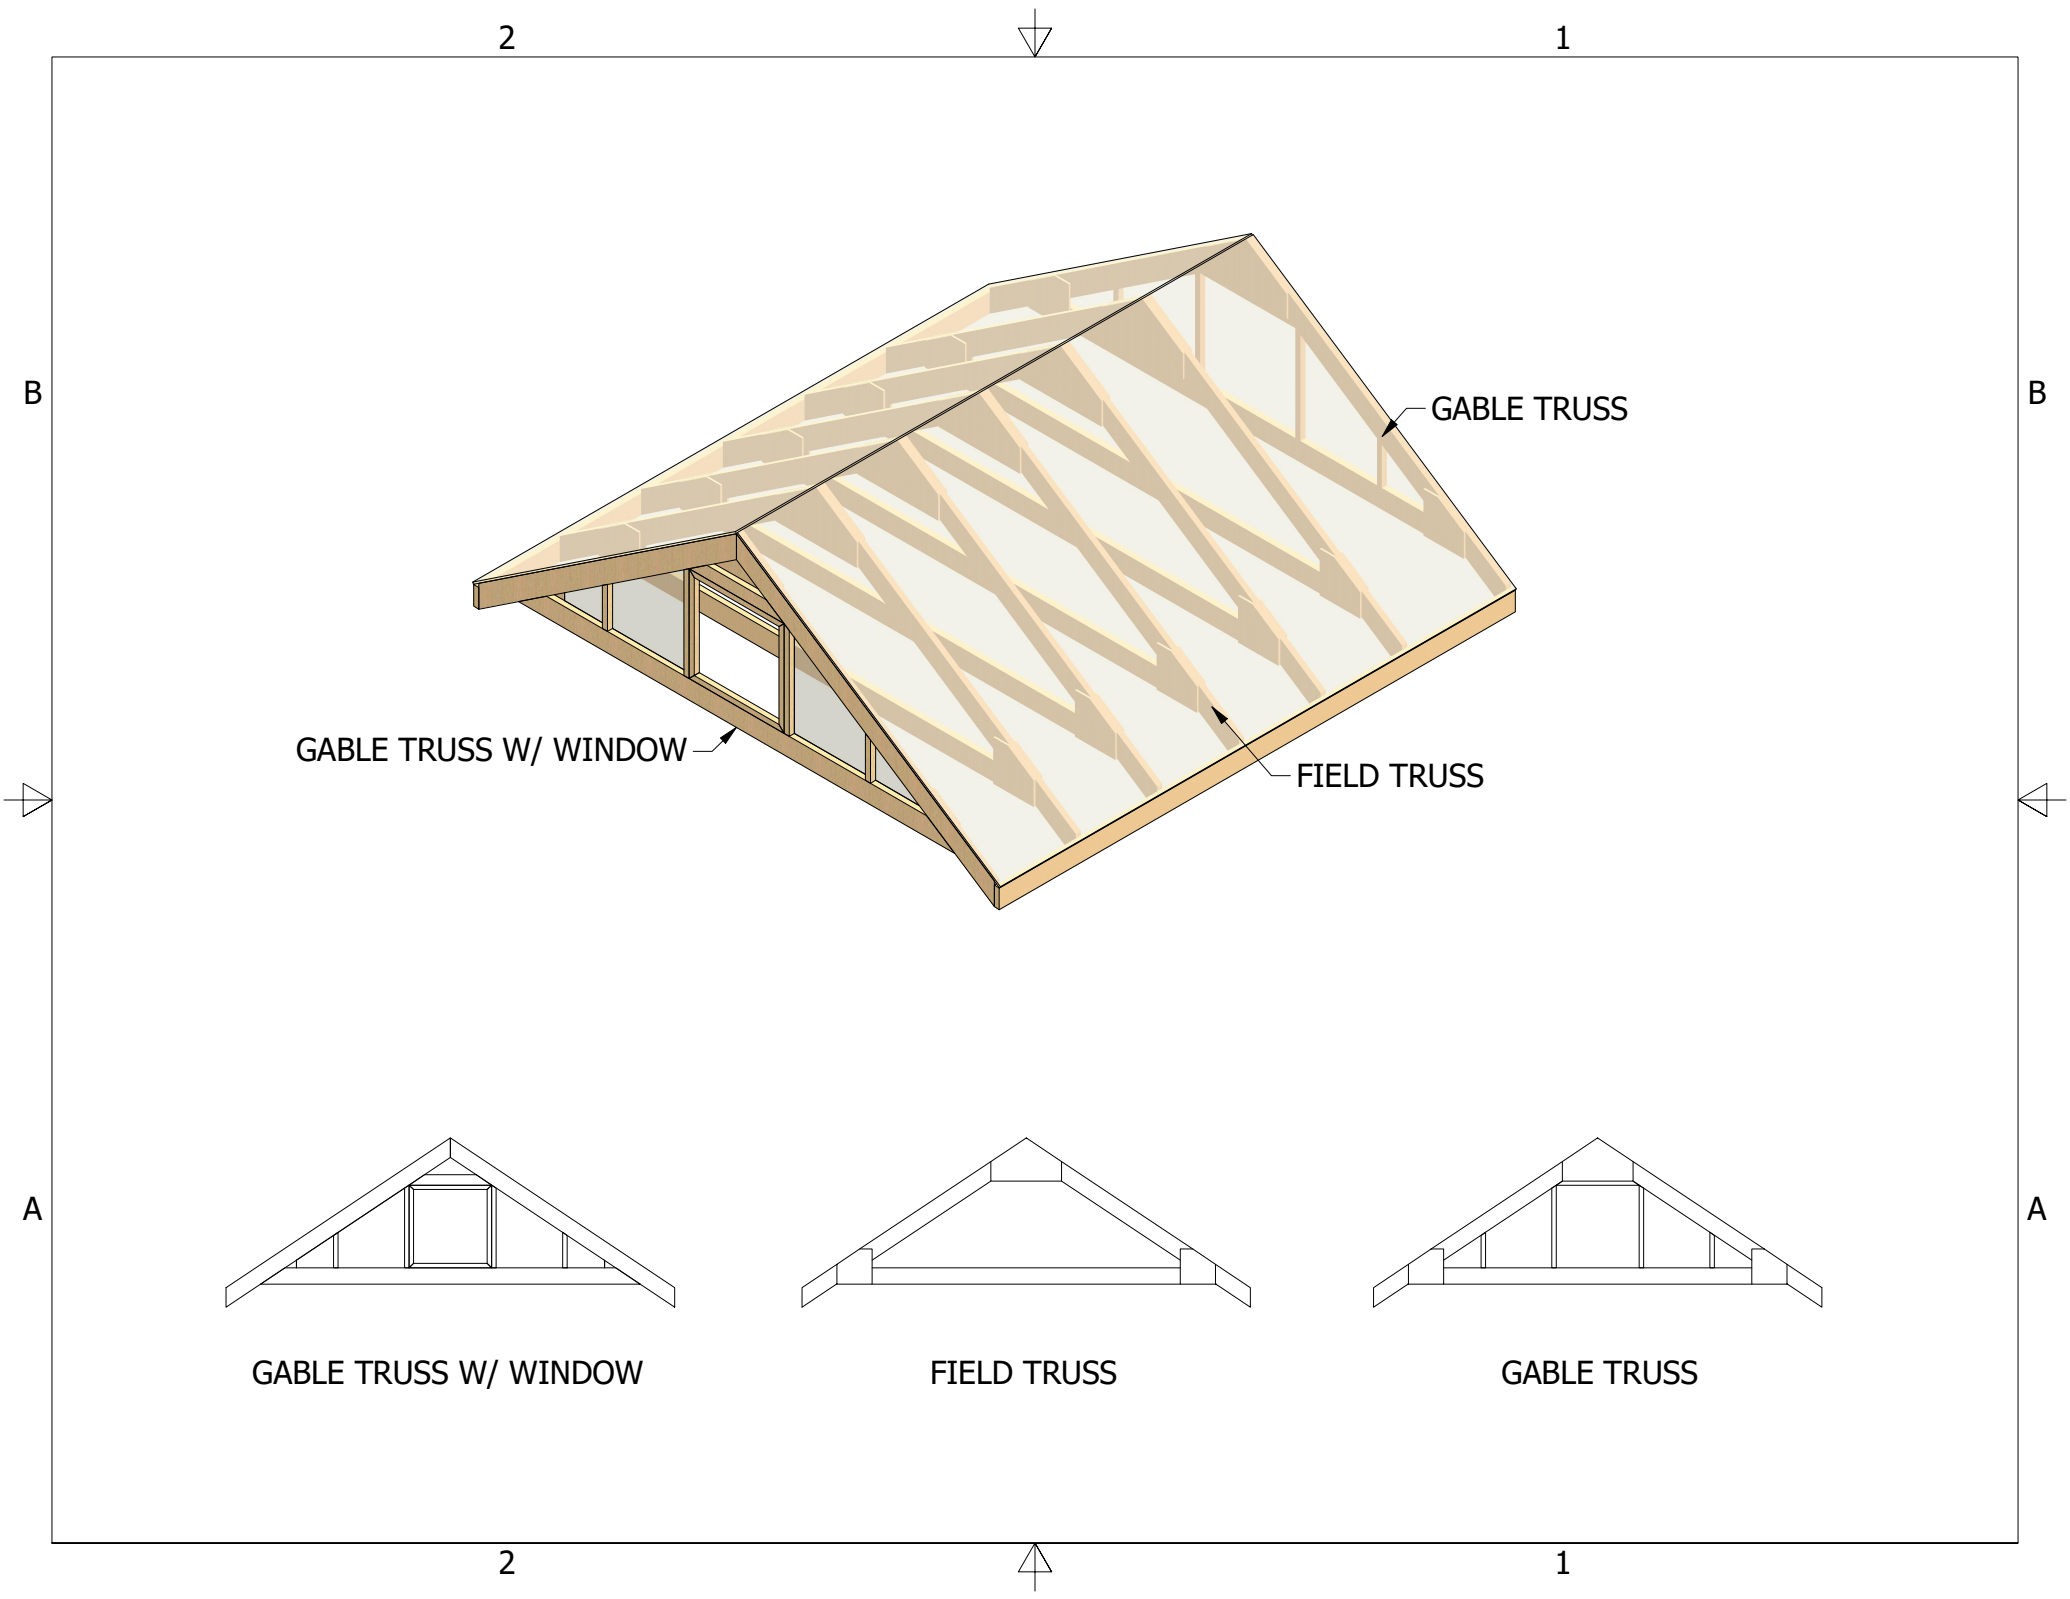

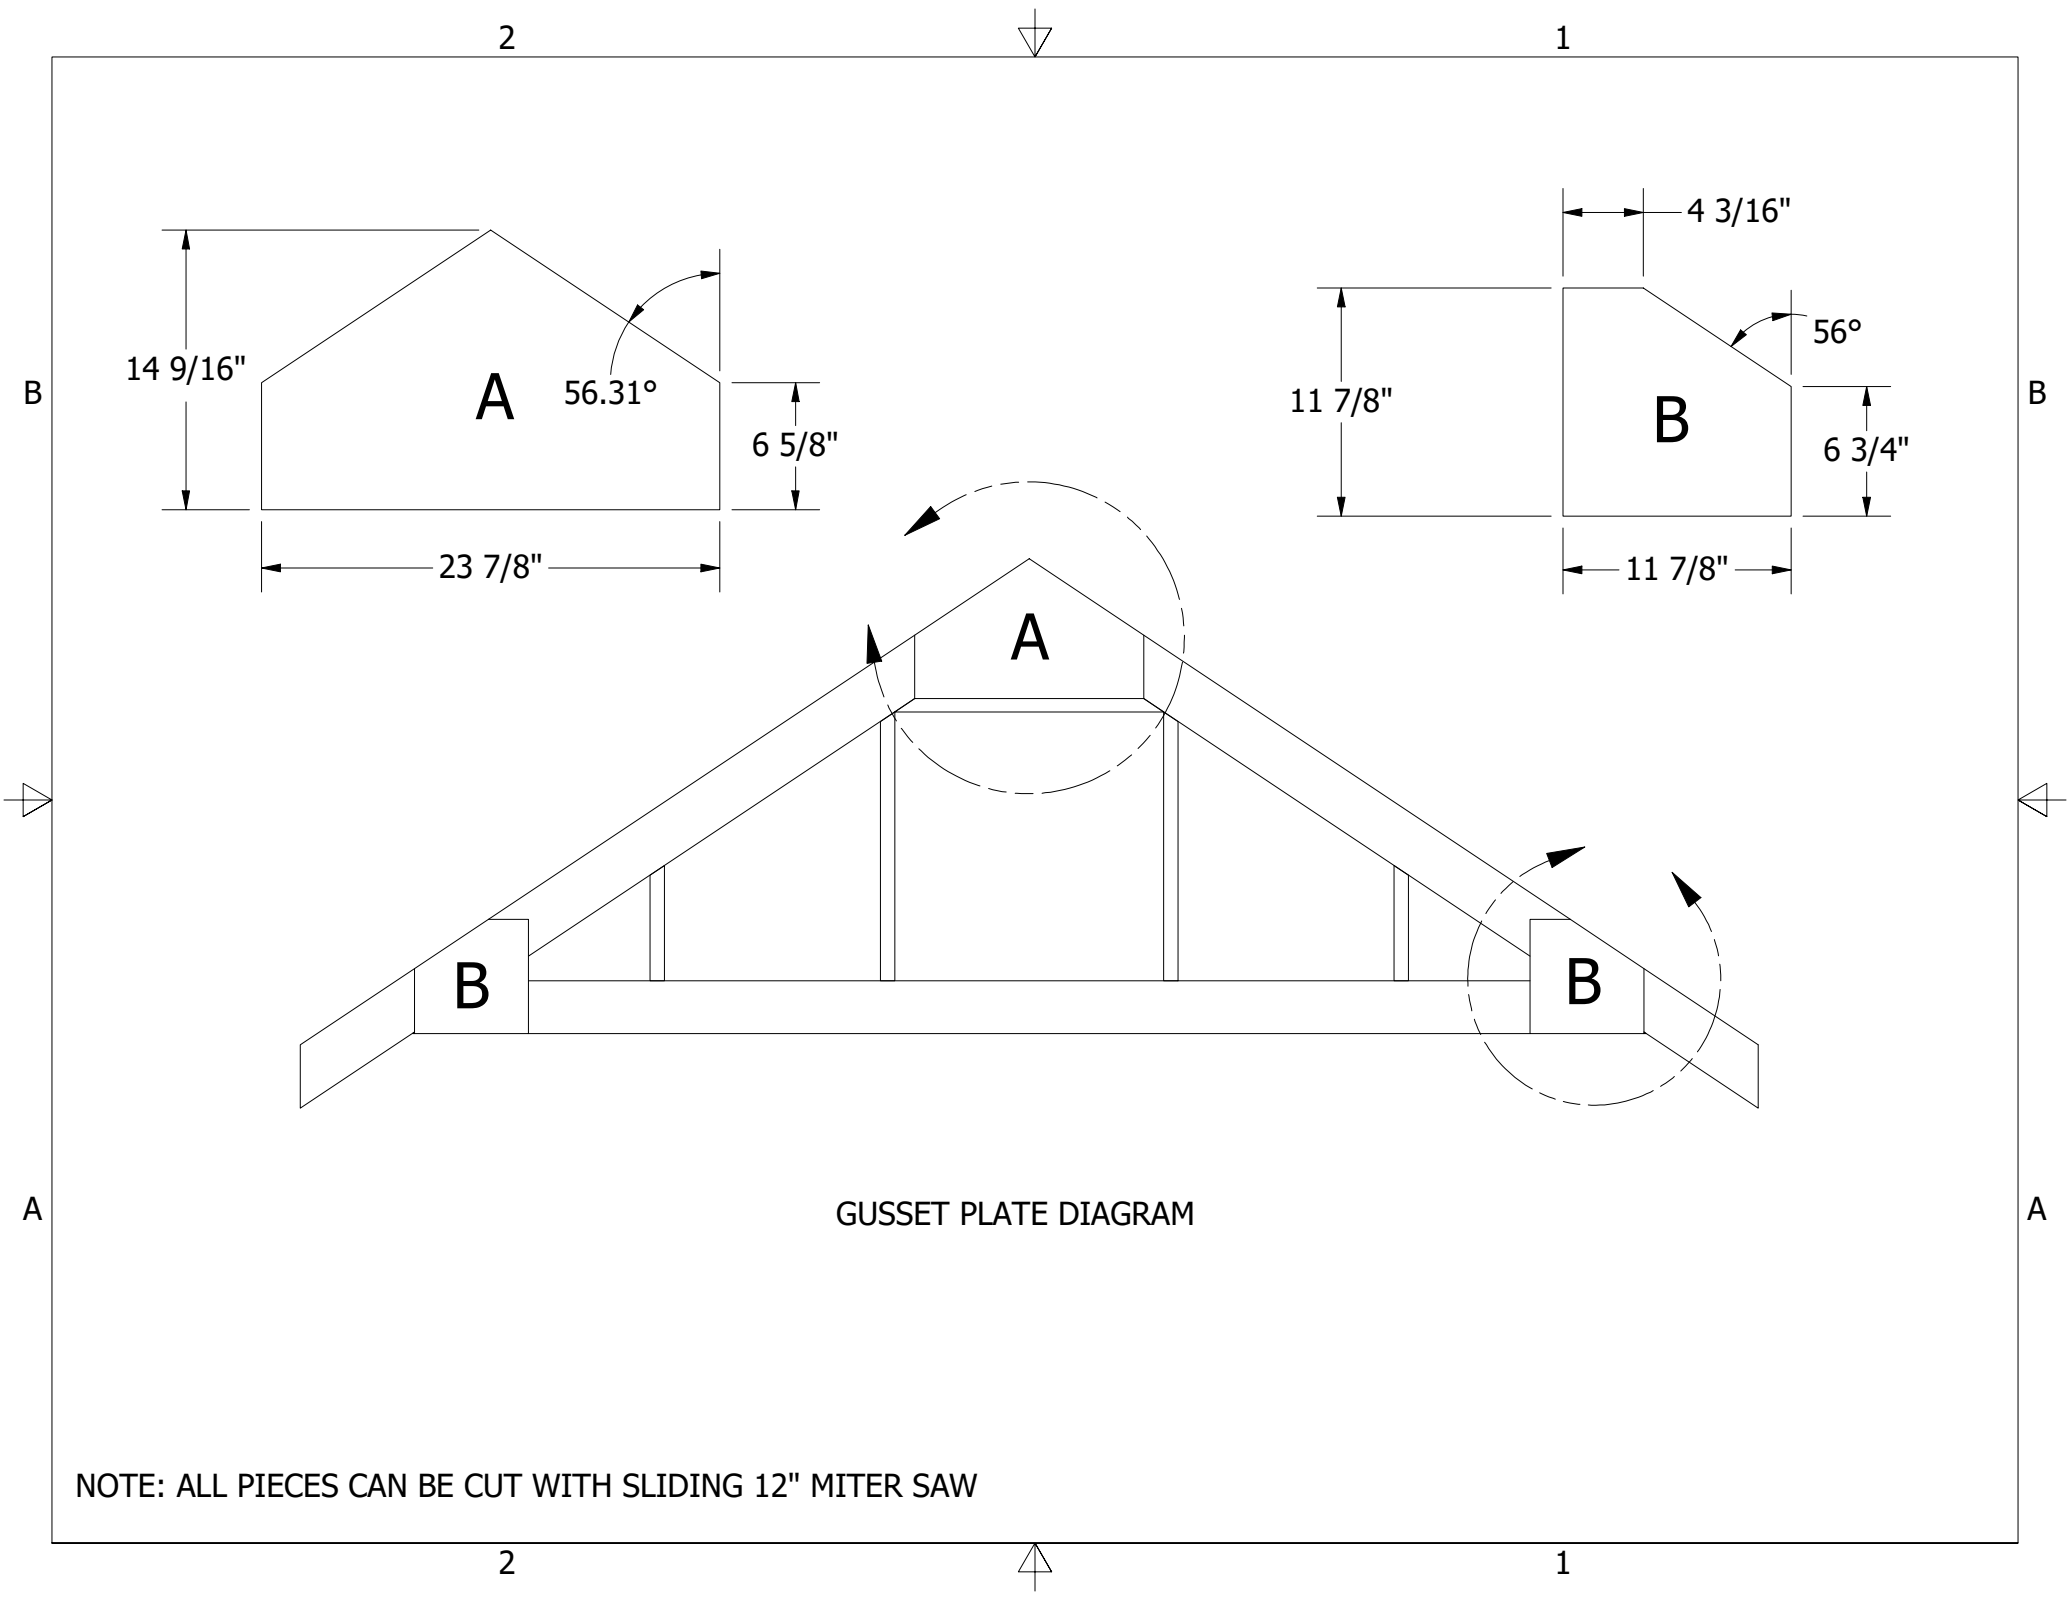

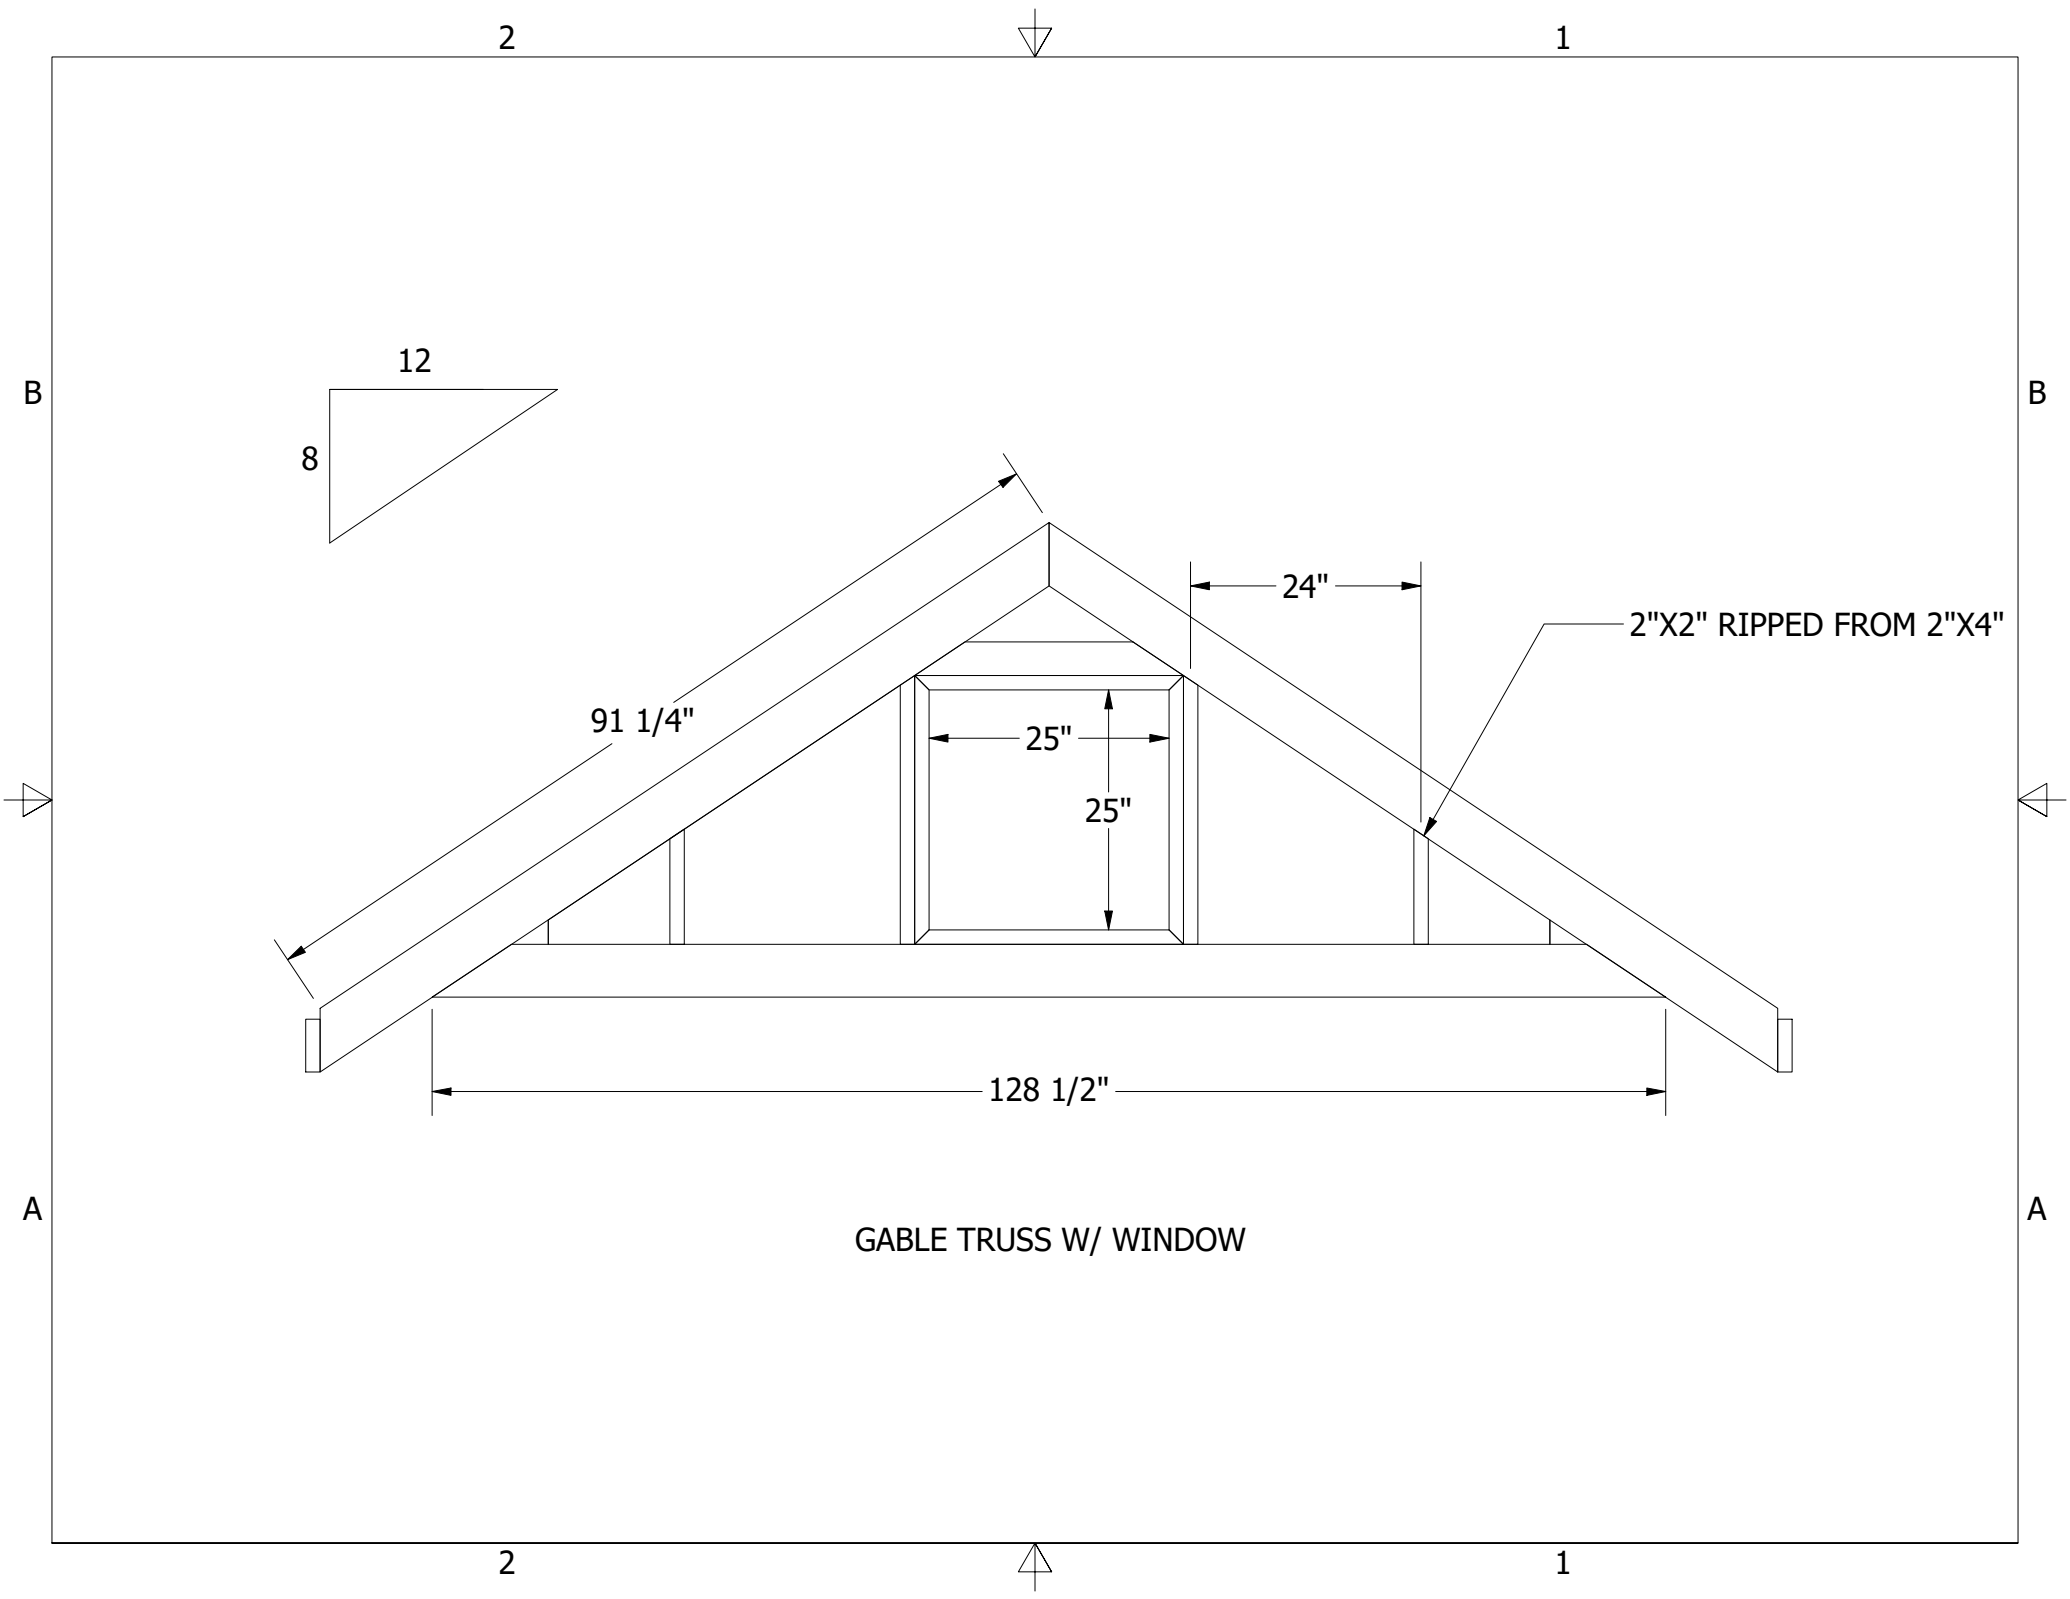

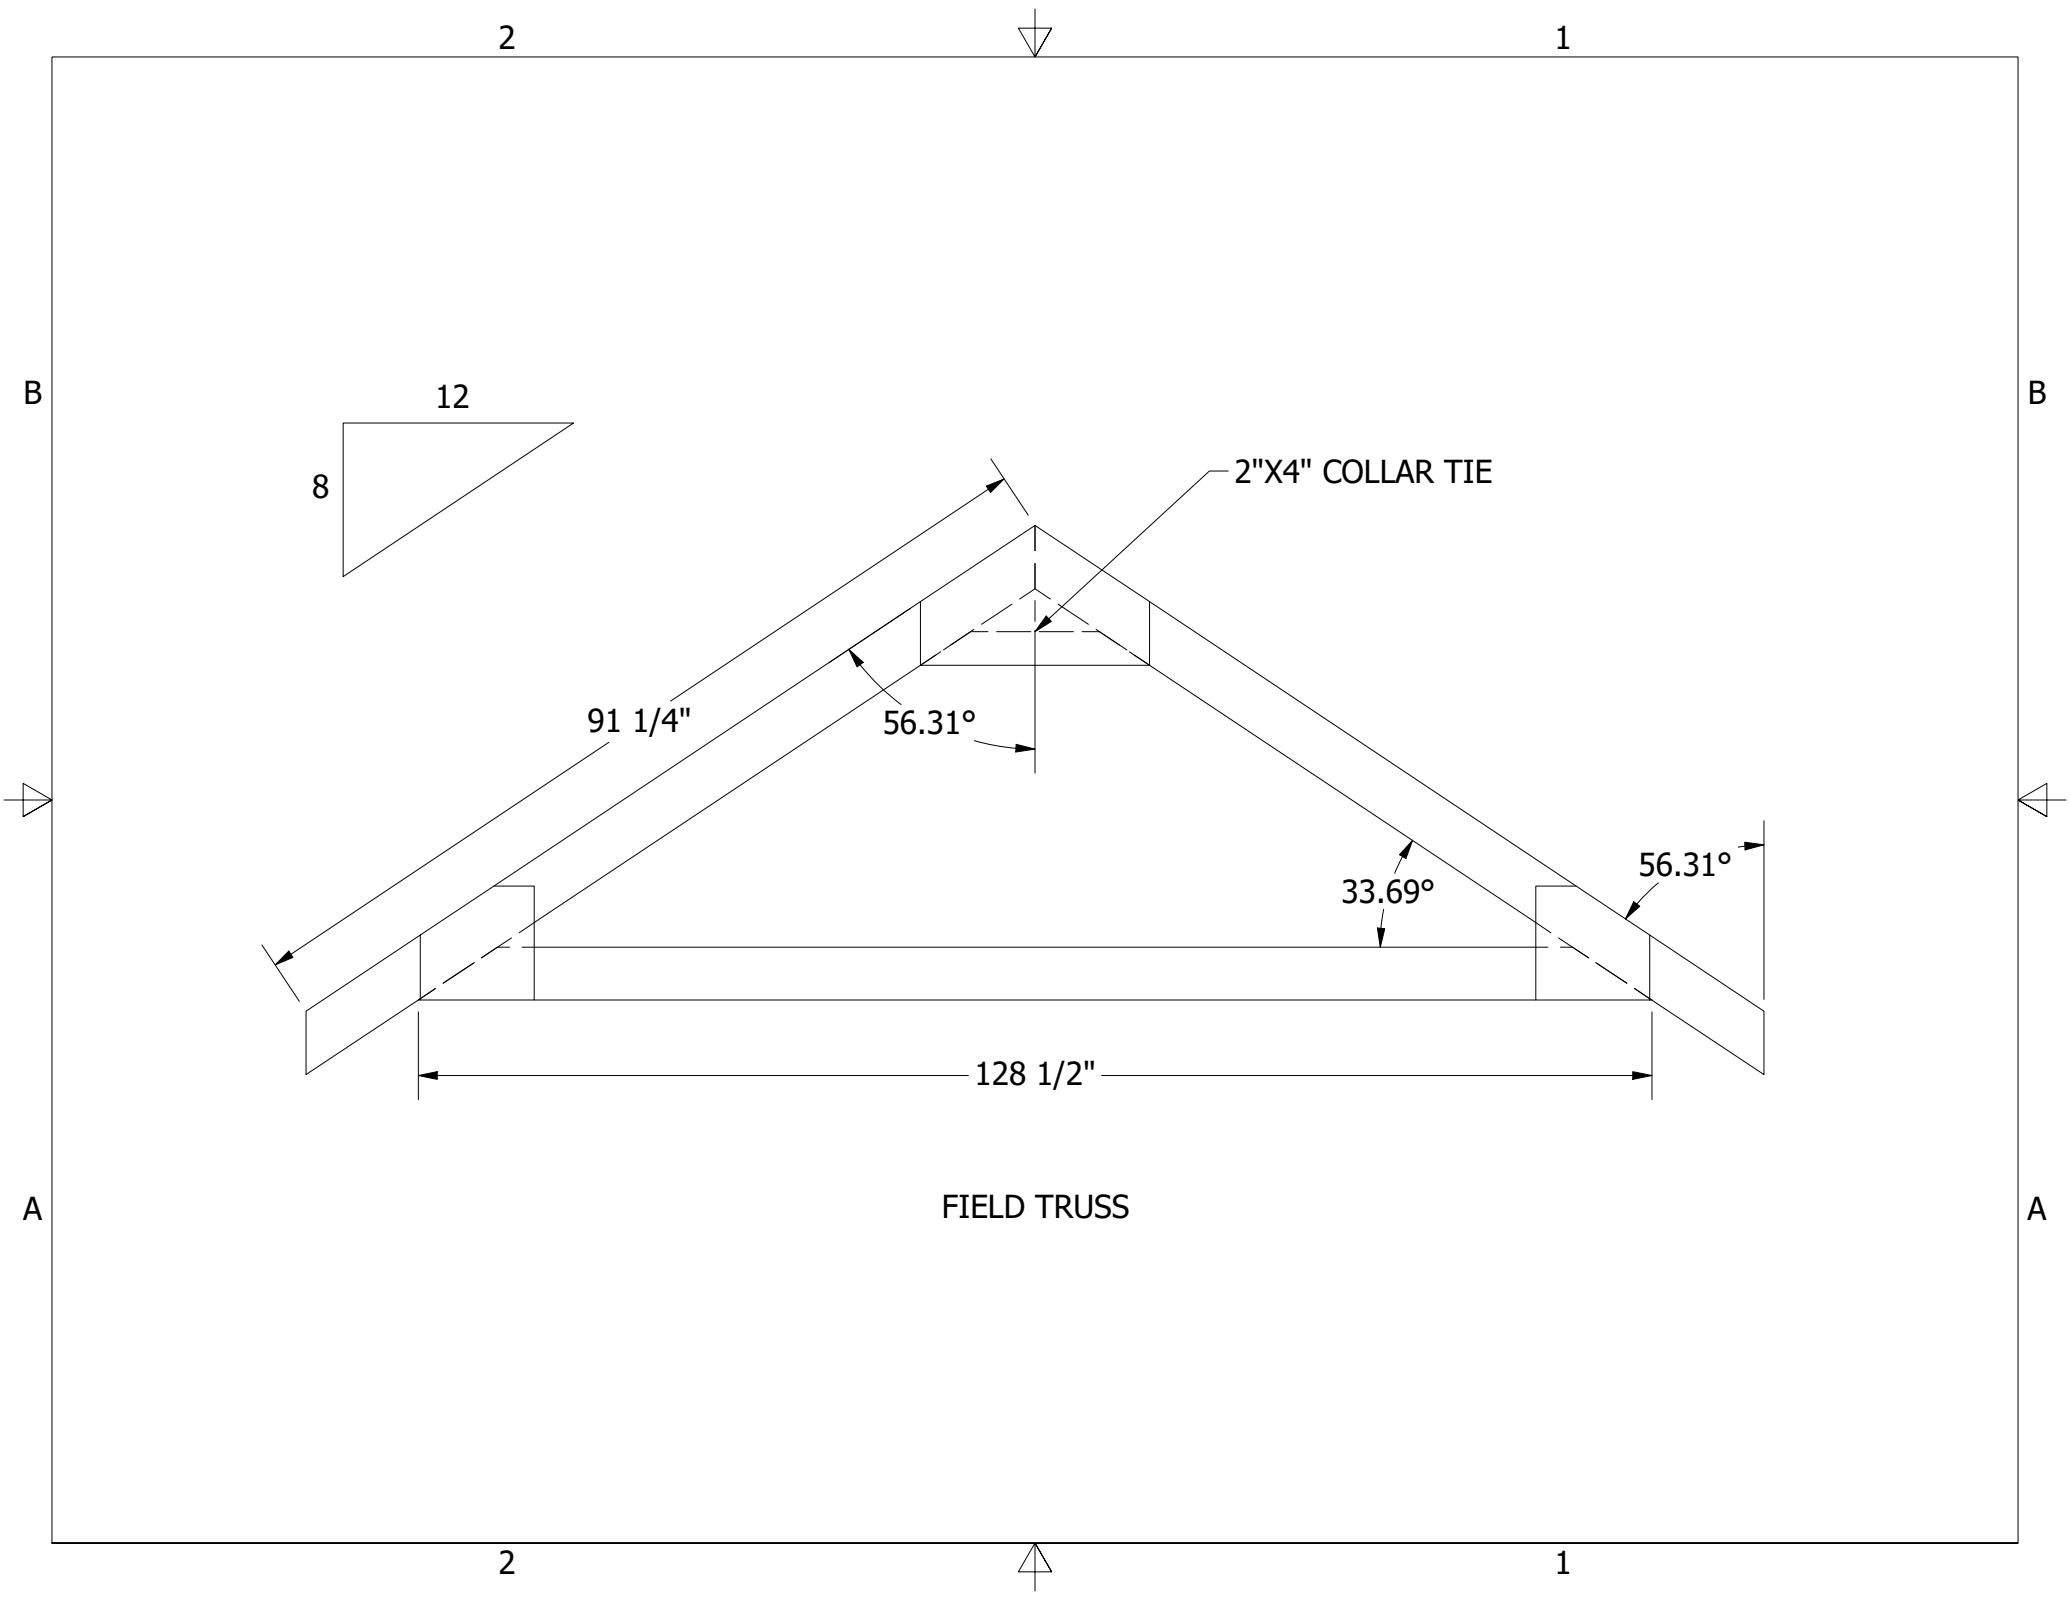

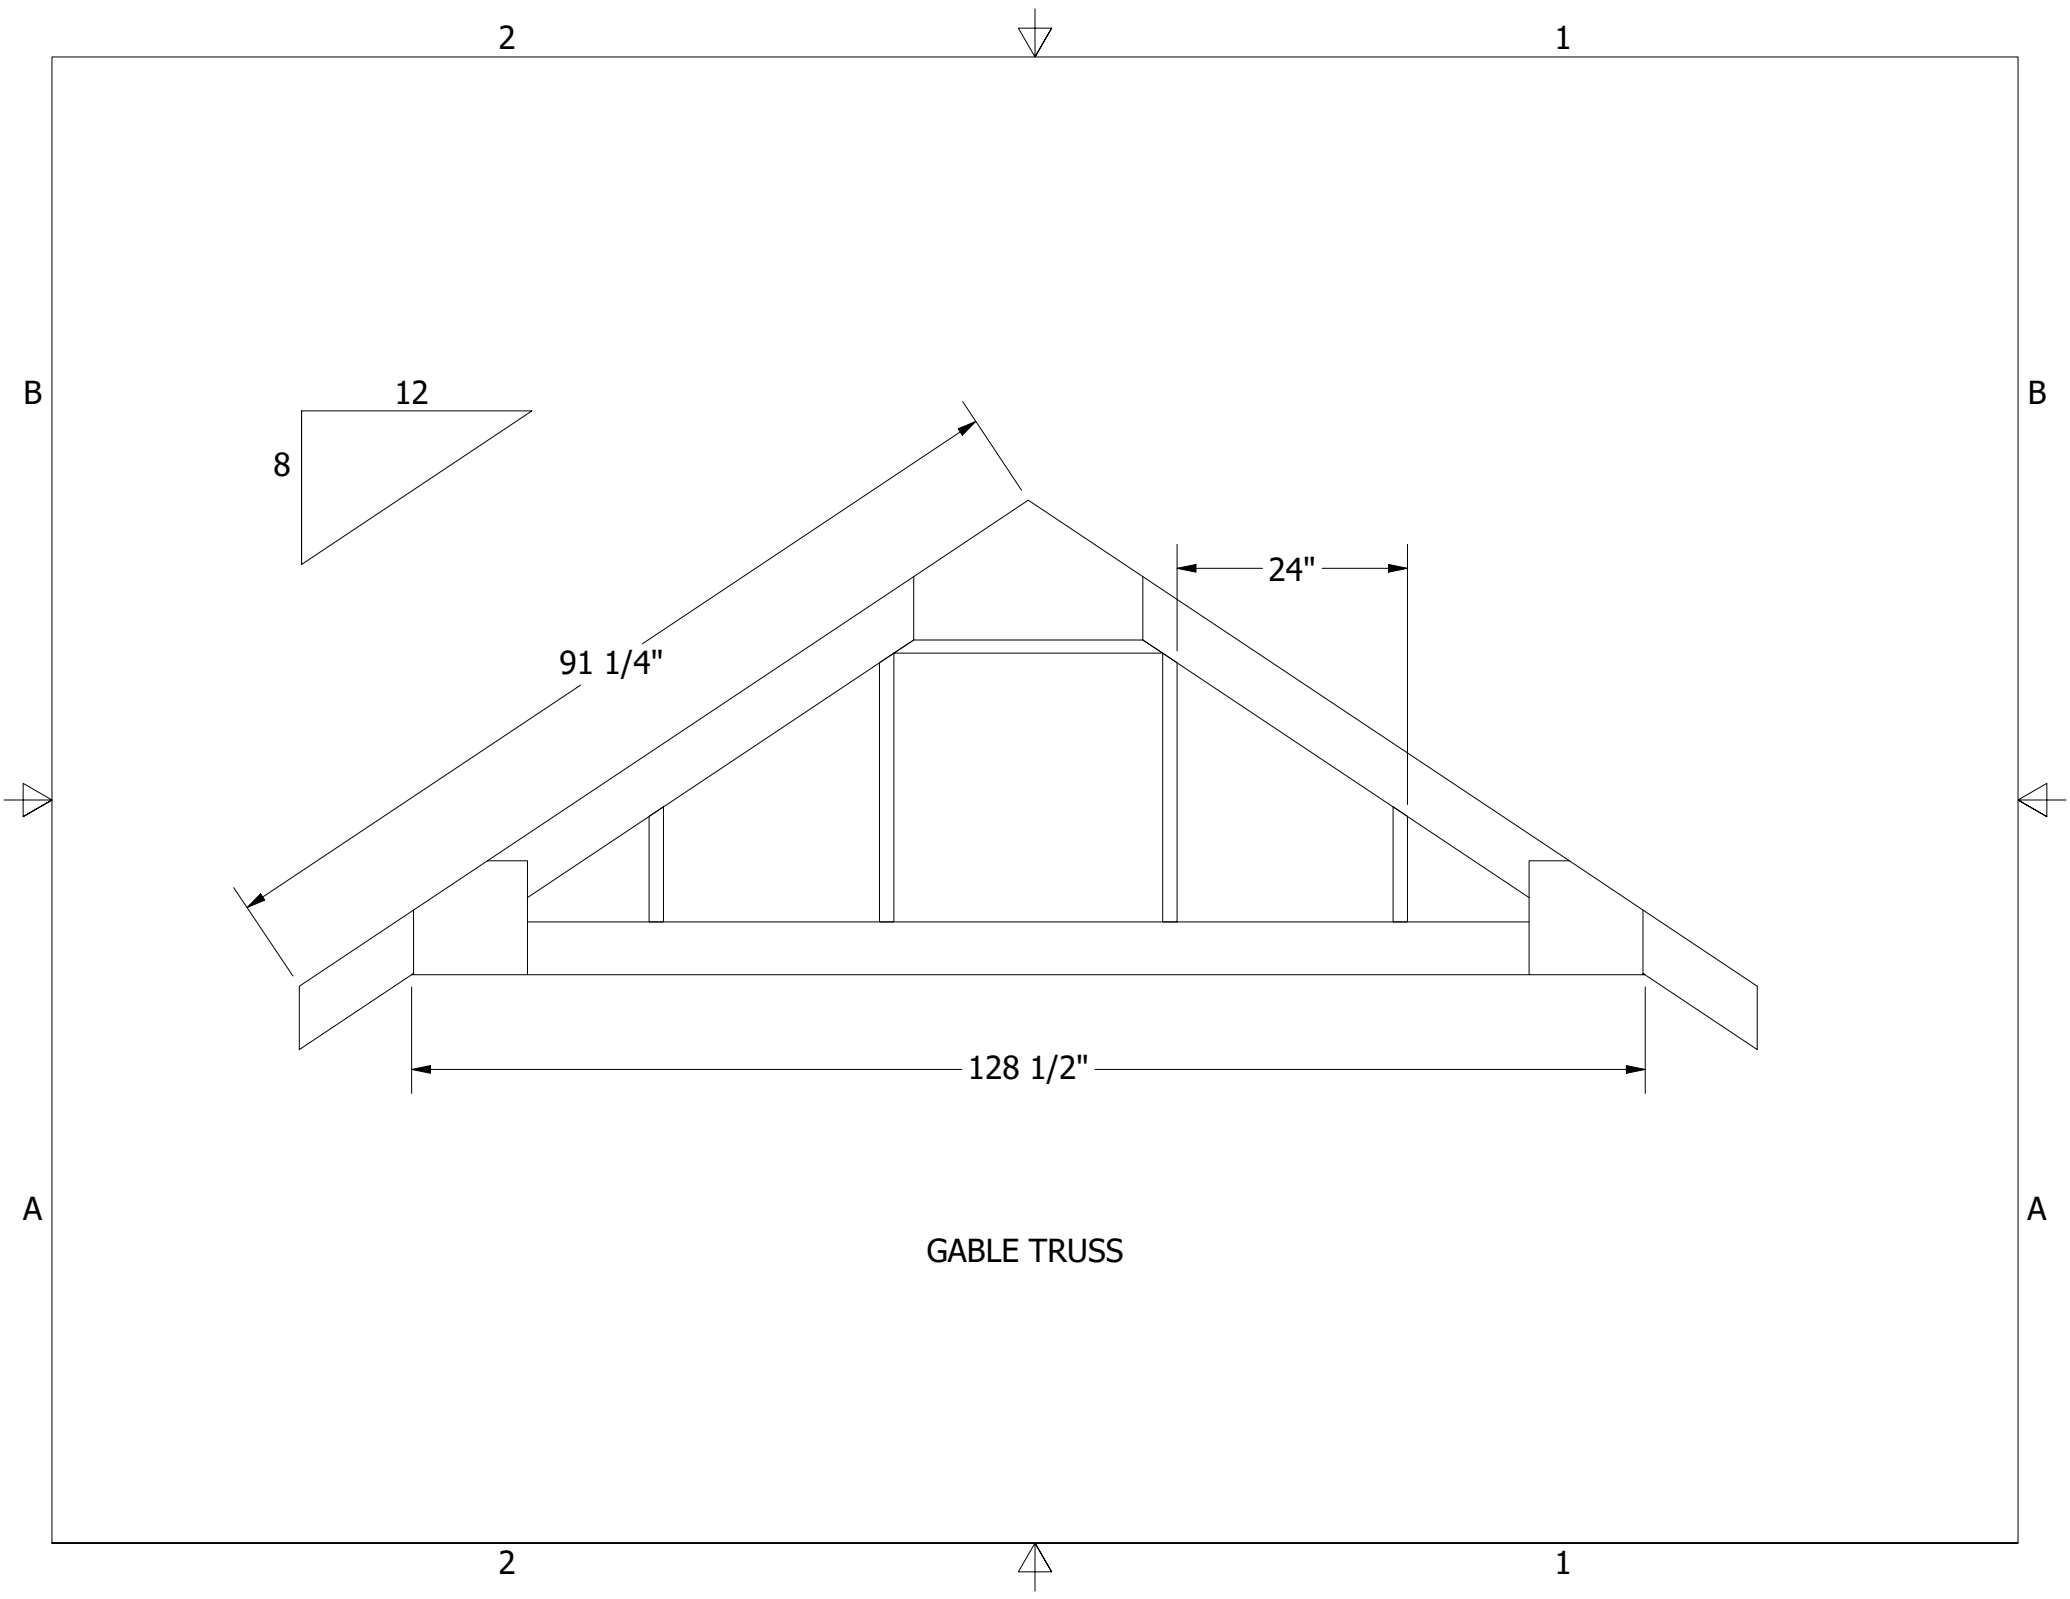

2

1

B

B



A

A

FIRE SAFETY RESEARCH INSTITUTE



Research
Institutes

HOSE STREAM PROP
HALLWAY DRAWINGS

2

1

